


01 FLOOR PLAN - MECHANICAL
 SCALE: 1/8"=1'-0"

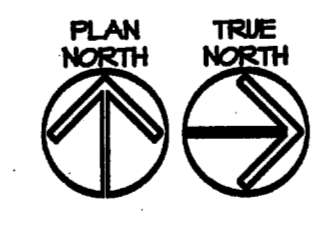

ROOFTOP EQUIPMENT COORDINATION NOTE:
 MECHANICAL CONTRACTOR SHALL COORDINATE FINAL ROOF TOP EQUIPMENT LOCATIONS SO AS TO FACILITATE EASE OF SERVICE, 10FT. MINIMUM DISTANCE BETWEEN INTAKE AND EXHAUST, PLUMBING VENT OR RELIEF AND BE 24' AWAY FROM ANY ROOF DRAIN OR ASSOCIATED CRICKETS.

STATE OF TEXAS
 Samuel G. Toub
 36988
 REGISTERED PROFESSIONAL ENGINEER

The seal on this document was authorized by Samuel G. Toub, P.E., 36988 on the date shown below.

2009.02.09
 Samuel G. Toub 14:18:33
 -06'00"

Project # 3926
S. Toub & Associates Inc.
 Consulting Engineer Mechanical / Electrical
 13841 Omega Road, Dallas, Texas 75244
 972/388-0823
 © COPYRIGHT 2008

JANI KING CALL CENTER
4393 SUNBELT DRIVE
 ADDISON, TEXAS