


DATE	
BY	
REVISIONS	
NO.	
PLAN	
NOTE BOOK	
ALIGNED CHECKED	
BY	
DATE	
NO.	

DATE	
BY	
REVISIONS	
NO.	
PROFILE	
NOTE BOOK	
GRADES CHECKED	
BY	
DATE	
NO.	

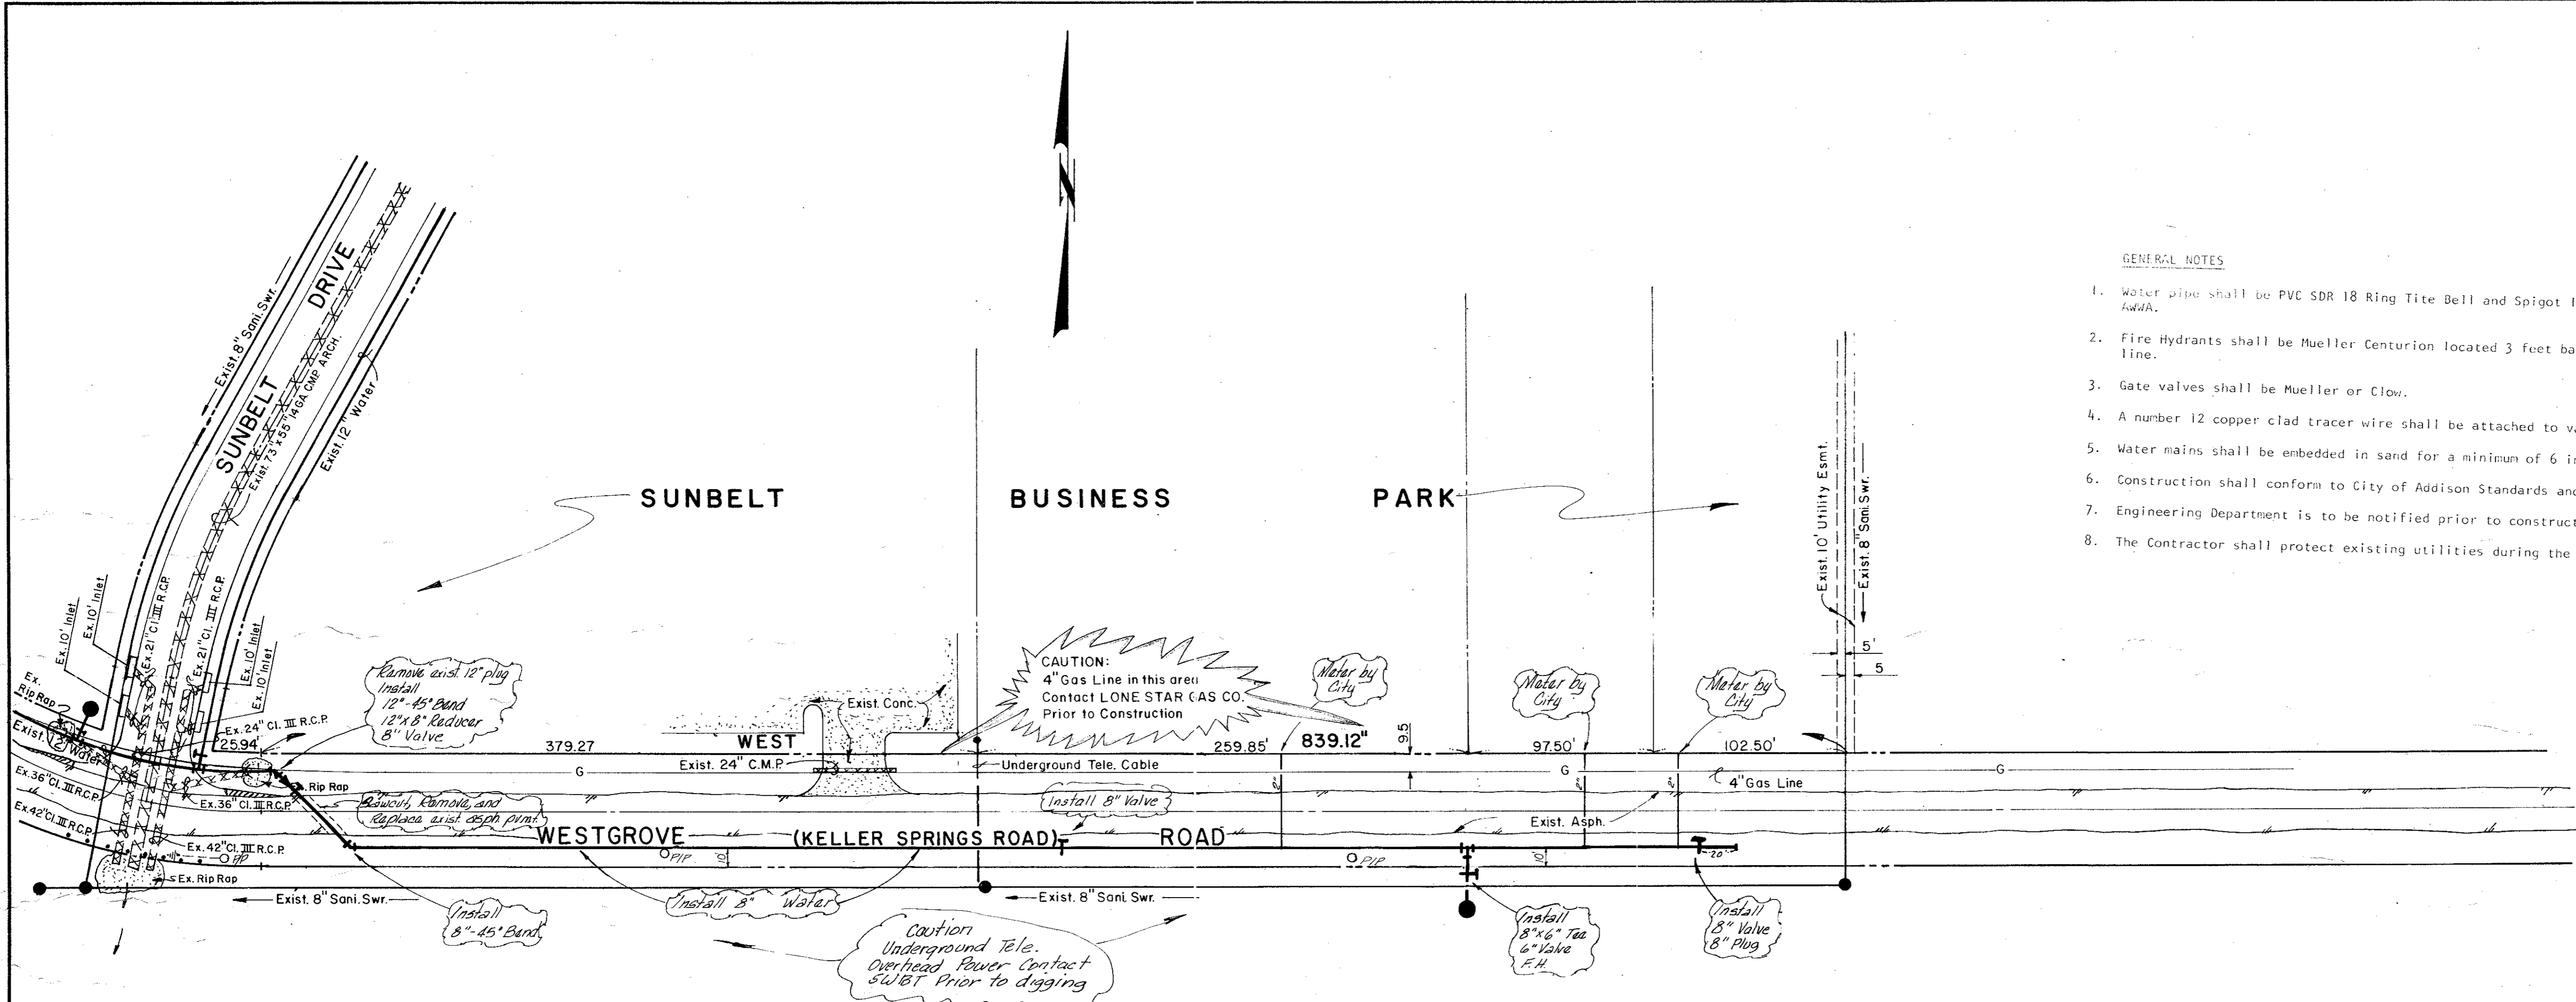

- GENERAL NOTES
1. Water pipe shall be PVC SDR 18 Ring Tite Bell and Spigot Integral wall as approved by Addis.
 2. Fire Hydrants shall be Mueller Centurion located 3 feet back of curb or 2 feet off property line.
 3. Gate valves shall be Mueller or Clow.
 4. A number 12 copper clad tracer wire shall be attached to valves and line.
 5. Water mains shall be embedded in sand for a minimum of 6 inches on all sides.
 6. Construction shall conform to City of Addison Standards and Specifications.
 7. Engineering Department is to be notified prior to construction.
 8. The Contractor shall protect existing utilities during the construction of this project.

- BENCH MARKS
1. R.R. Spike in P.P.E. Side Of ADDISON RD. 30'± South of SUNBELT DR. ELEV. 644.35
 2. "□" On Top West End Of 18" R.C.P. Under GRAVEL DR. To Sewer Plant. ELEV. 624.84

CITY OF ADDISON
APPROVED
 CONSTRUCTION
 BUILDING DEPARTMENT
 3-11-80
 DATE: 3-11-80
 CONTRACTOR IS HEREBY NOTIFIED TO
 USE CARE IN THE CONSTRUCTION OF THIS
 WORK AND TO PROTECT ALL UTILITIES
 LOCATED UNDER OR ADJACENT TO THE WORK.
 APPROVAL OF THIS DRAWING DOES NOT
 IMPLY ANY RESPONSIBILITY OR LIABILITY
 TO SUCH CONTRACTORS.

Revised 3-4-80

8" WATER MAIN EXTENSION						
SUNBELT BUSINESS PARK						
FOR LLOYD BLAYLOCK						
CITY OF ADDISON, TEXAS						
RAYMOND L. GOODSON JR. INC., ENGINEERS						
DESIGN	DRAWN	DATE	SCALE	NOTES	FILE	NO.
R.L.G. INC.	INC.	11-20-79 2-22-80	1"=50'H	R.L.G. INC.		