


- 1. DOORS ON AN ACCESSIBLE ROUTE MUST BE 36" WIDE MINIMUM TO PROVIDE 32" MINIMUM CLEARANCE. NOTIFY THE ARCHITECT OF CONFLICTS FOR RESOLUTION PRIOR TO CONSTRUCTION.
- 2. ALL DOOR LOCKSETS, LATCHSETS, AND PANIC HARDWARE SHALL COMPLY WITH TEXAS ACCESSIBILITY STANDARDS, TAS (ADA) STANDARDS 4, 9, AND 13 AND HAVE A MAXIMUM OPERATING FORCE OF 5 LBS. AT INTERIOR DOORS AND 8 LBS. AT EXTERIOR DOORS.
- 3. MANEUVERING CLEARANCES AT ALL DOORS SHALL COMPLY WITH TEXAS ACCESSIBILITY STANDARDS, AND A.D.A. STANDARDS.

3 ACCESSIBLE DOOR DIAGRAM

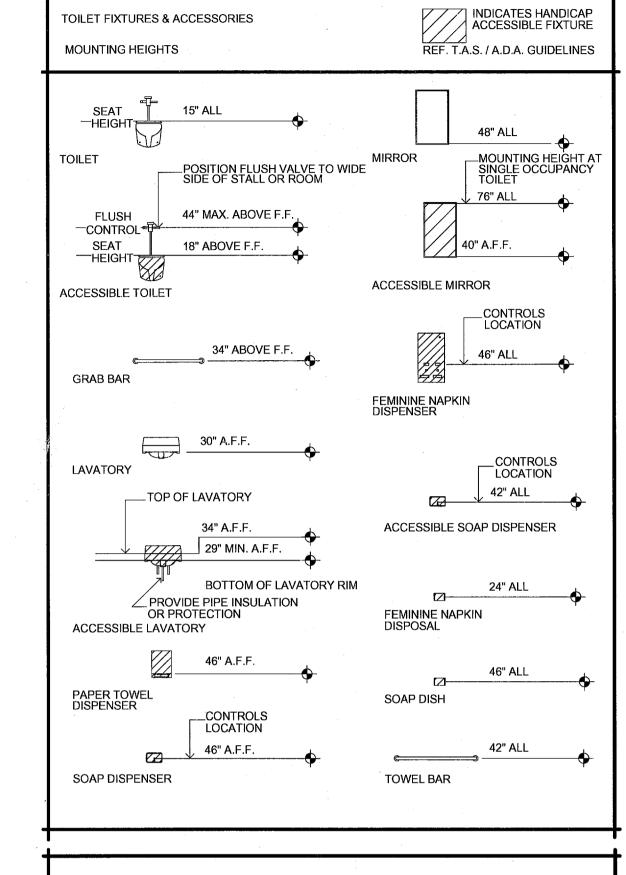

Texas MG


Town of Addison, SURVEYOR 1.5

A-100


ccessibility

**GENERAL NOTE:** 

DETAILS SHOWN ON THIS SHEET ARE TYPICAL AND APPLY TO WHEREVER CONDITION SHOWN IN DETAIL OCCURS.

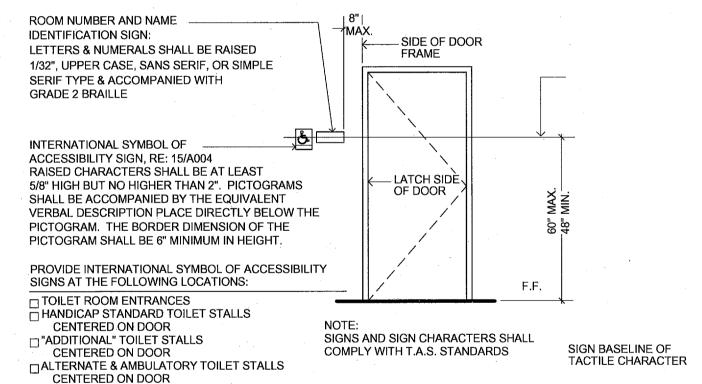


4 DOOR / ENTRANCE SIGN SCALE 3/8" = 1'- 0"

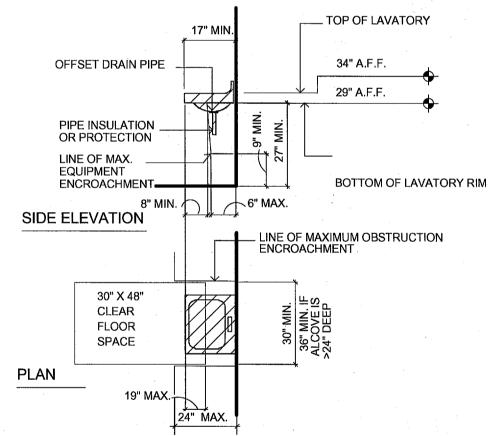



**ACCESSIBLE LAVATORY** 

SCALE: 3/8"=1'-0" NOTE: REFER ARCHITECTURAL FLOOR PLANS FOR LOCATION OF ACCESSIBLE FIXTURES (ACCESSIBLE FIXTURES ARE INDICATED BY

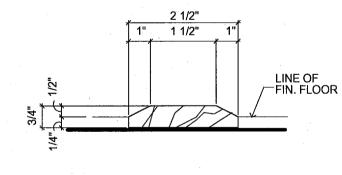

6 MARBLE THRESHOLD SCALE 6" = 1'-0"

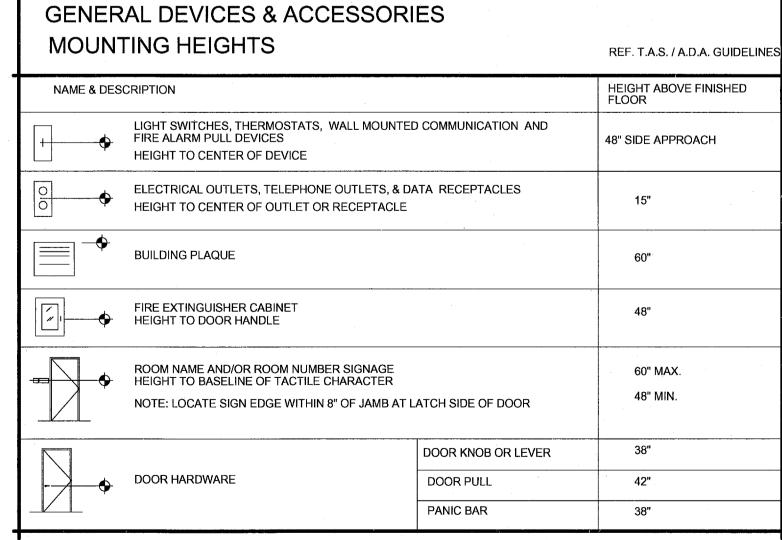

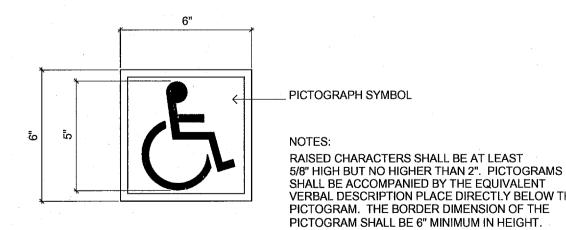

SHALL BE ACCOMPANIED BY THE EQUIVALENT VERBAL DESCRIPTION PLACE DIRECTLY BELOW THE PICTOGRAM. THE BORDER DIMENSION OF THE PICTOGRAM SHALL BE 6" MINIMUM IN HEIGHT.

7 INTERNATIONAL SYMBOL OF ACCESSIBILITY

SCALE 3" = 1'- 0"