


ACAD: Rel: 18.0s (LWS Tech) User: ppm File: N:\elec\EL-ADD-PL-ELEV.dwg Date: Jan 18, 2011 - 4:18pm
 [ADD08459] [DINSRV2] N:\elec\EL-ADD-PL-ELEV.dwg LAYOUT: EL-ADD-PL-ELEV.dwg User: ppm File: N:\elec\EL-ADD-PL-ELEV.dwg Date: Jan 18, 2011 - 4:18pm
 PSLTS: 1 TWTST: CI\ALI\FREESE.COM
 LTS: 1
 REFERENCES: N:\elec\Bose\WMM-STAMP.dwg, N:\elec\Bose\util-tank-elevation.dwg, N:\elec\Bose\util-tank-elevation.dwg, N:\elec\Bose\util-tank-elevation.dwg, N:\elec\Bose\util-tank-elevation.dwg, N:\elec\Bose\util-tank-elevation.dwg, N:\elec\Bose\util-tank-elevation.dwg, N:\elec\Bose\util-tank-elevation.dwg, N:\elec\Bose\util-tank-elevation.dwg, N:\elec\Bose\util-tank-elevation.dwg

GENERAL NOTES:


1. CONDUITS ROUTED TO JUNCTION BOXES IN THE VAULT SHALL TERMINATE THE TOP HALF OF THE JUNCTION BOX. CONDUIT DRAINS SHALL TERMINATE THE BOTTOM OF THE JUNCTION BOX.
2. CONDUITS IN THE VAULT SHALL BE RIGID ALUMINUM.
3. CONTRACTOR SHALL PROVIDE LIGHTNING PROTECTION IN ACCORDANCE WITH LP1 AND TURBINE MANUFACTURER RECOMMENDATIONS.
4. CONDUITS ROUTED ON TOP OF TANK BOWL SHALL BE COORDINATED WITH TANK BOWL FABRICATOR SUCH THAT FABRICATOR PROVIDES STUDS WELDED TO TANK BOWL ALLOWING CHANNEL UNISTRUT TO BE SECURED FOR CONDUIT SUPPORTS.

NOTES BY SYMBOL "◇"


1. PROVIDE 2 #12, #12G., 1/4" C. TO TANK MIXER SYSTEM. CONTRACTOR SHALL COORDINATE CABLE ROUTING WITH TANK MANUFACTURER AND TANK MIXER MANUFACTURER.
2. PROVIDE JUNCTION BOX FOR ANALOG SIGNALS. PROVIDE CONDUIT DRAIN ON ENCLOSURE.
3. PROVIDE JUNCTION BOX FOR DIGITAL SIGNALS. PROVIDE CONDUIT DRAIN ON ENCLOSURE.
4. PROVIDE JUNCTION BOX FOR 120V POWER. PROVIDE CONDUIT DRAIN ON ENCLOSURE.
5. CONDUITS ENTERING/LEAVING VAULT SHALL BE SEALED WITH LINK SEAL.
6. COORDINATE CONDUIT ACCESS THROUGH THE MANWAY WITH BOWL MANUFACTURER.
7. CONTRACTOR SHALL PROVIDE PANEL TP AND POWER METER, RE: 1/E-5.
8. CONTRACTOR SHALL INSTALL EQUIPMENT FROM TURBINE MANUFACTURER, RE: E-5 AND E-6.
9. RECEPTACLES SHALL BE MOUNTED 2'-0" AFF.
10. PROVIDE SUMP PUMP WITH INTEGRAL FLOAT.
11. CONTRACTOR SHALL SIZE CONDUIT BASED ON NATIONAL ELECTRICAL CODE. MULTIPLE CONDUITS IS SUGGESTED.
12. PRESSURE TRANSMITTER SHALL INCLUDE 3-WAY BLOCK AND BLEED VALVE AND ISOLATION VALVE.
13. VENTILATION FAN SHALL BE MOUNTED TO THE TOP OF VALVE VAULT. ROUTE CONDUIT AND CONDUCTORS PER MANUFACTURERS RECOMMENDATION. CONDUIT SHALL NOT BE ROUTED ON VALVE VAULT TOP.
14. CONDUITS REQUIRED THROUGH THE ACCESS TUBE (TO THE TOP OF THE ELEVATED STORAGE TANK) SHALL BE ROUTED AND SUPPORTED ON THE WALKWAY.
15. POWER TO EMERGENCY LIGHTING SHALL BE ROUTED THROUGH THE RECEPTACLE AS A MEANS OF DISCONNECT.
16. LIGHTS IN VALVE VAULT SHALL BE MOUNTED 6'-0" AFF.
17. SWITCHES SHALL BE MOUNTED NEAR TOP OF LADDER NEAR HATCH.
18. MOUNT FLOAT TO ACTIVATE AT 6" AFF.

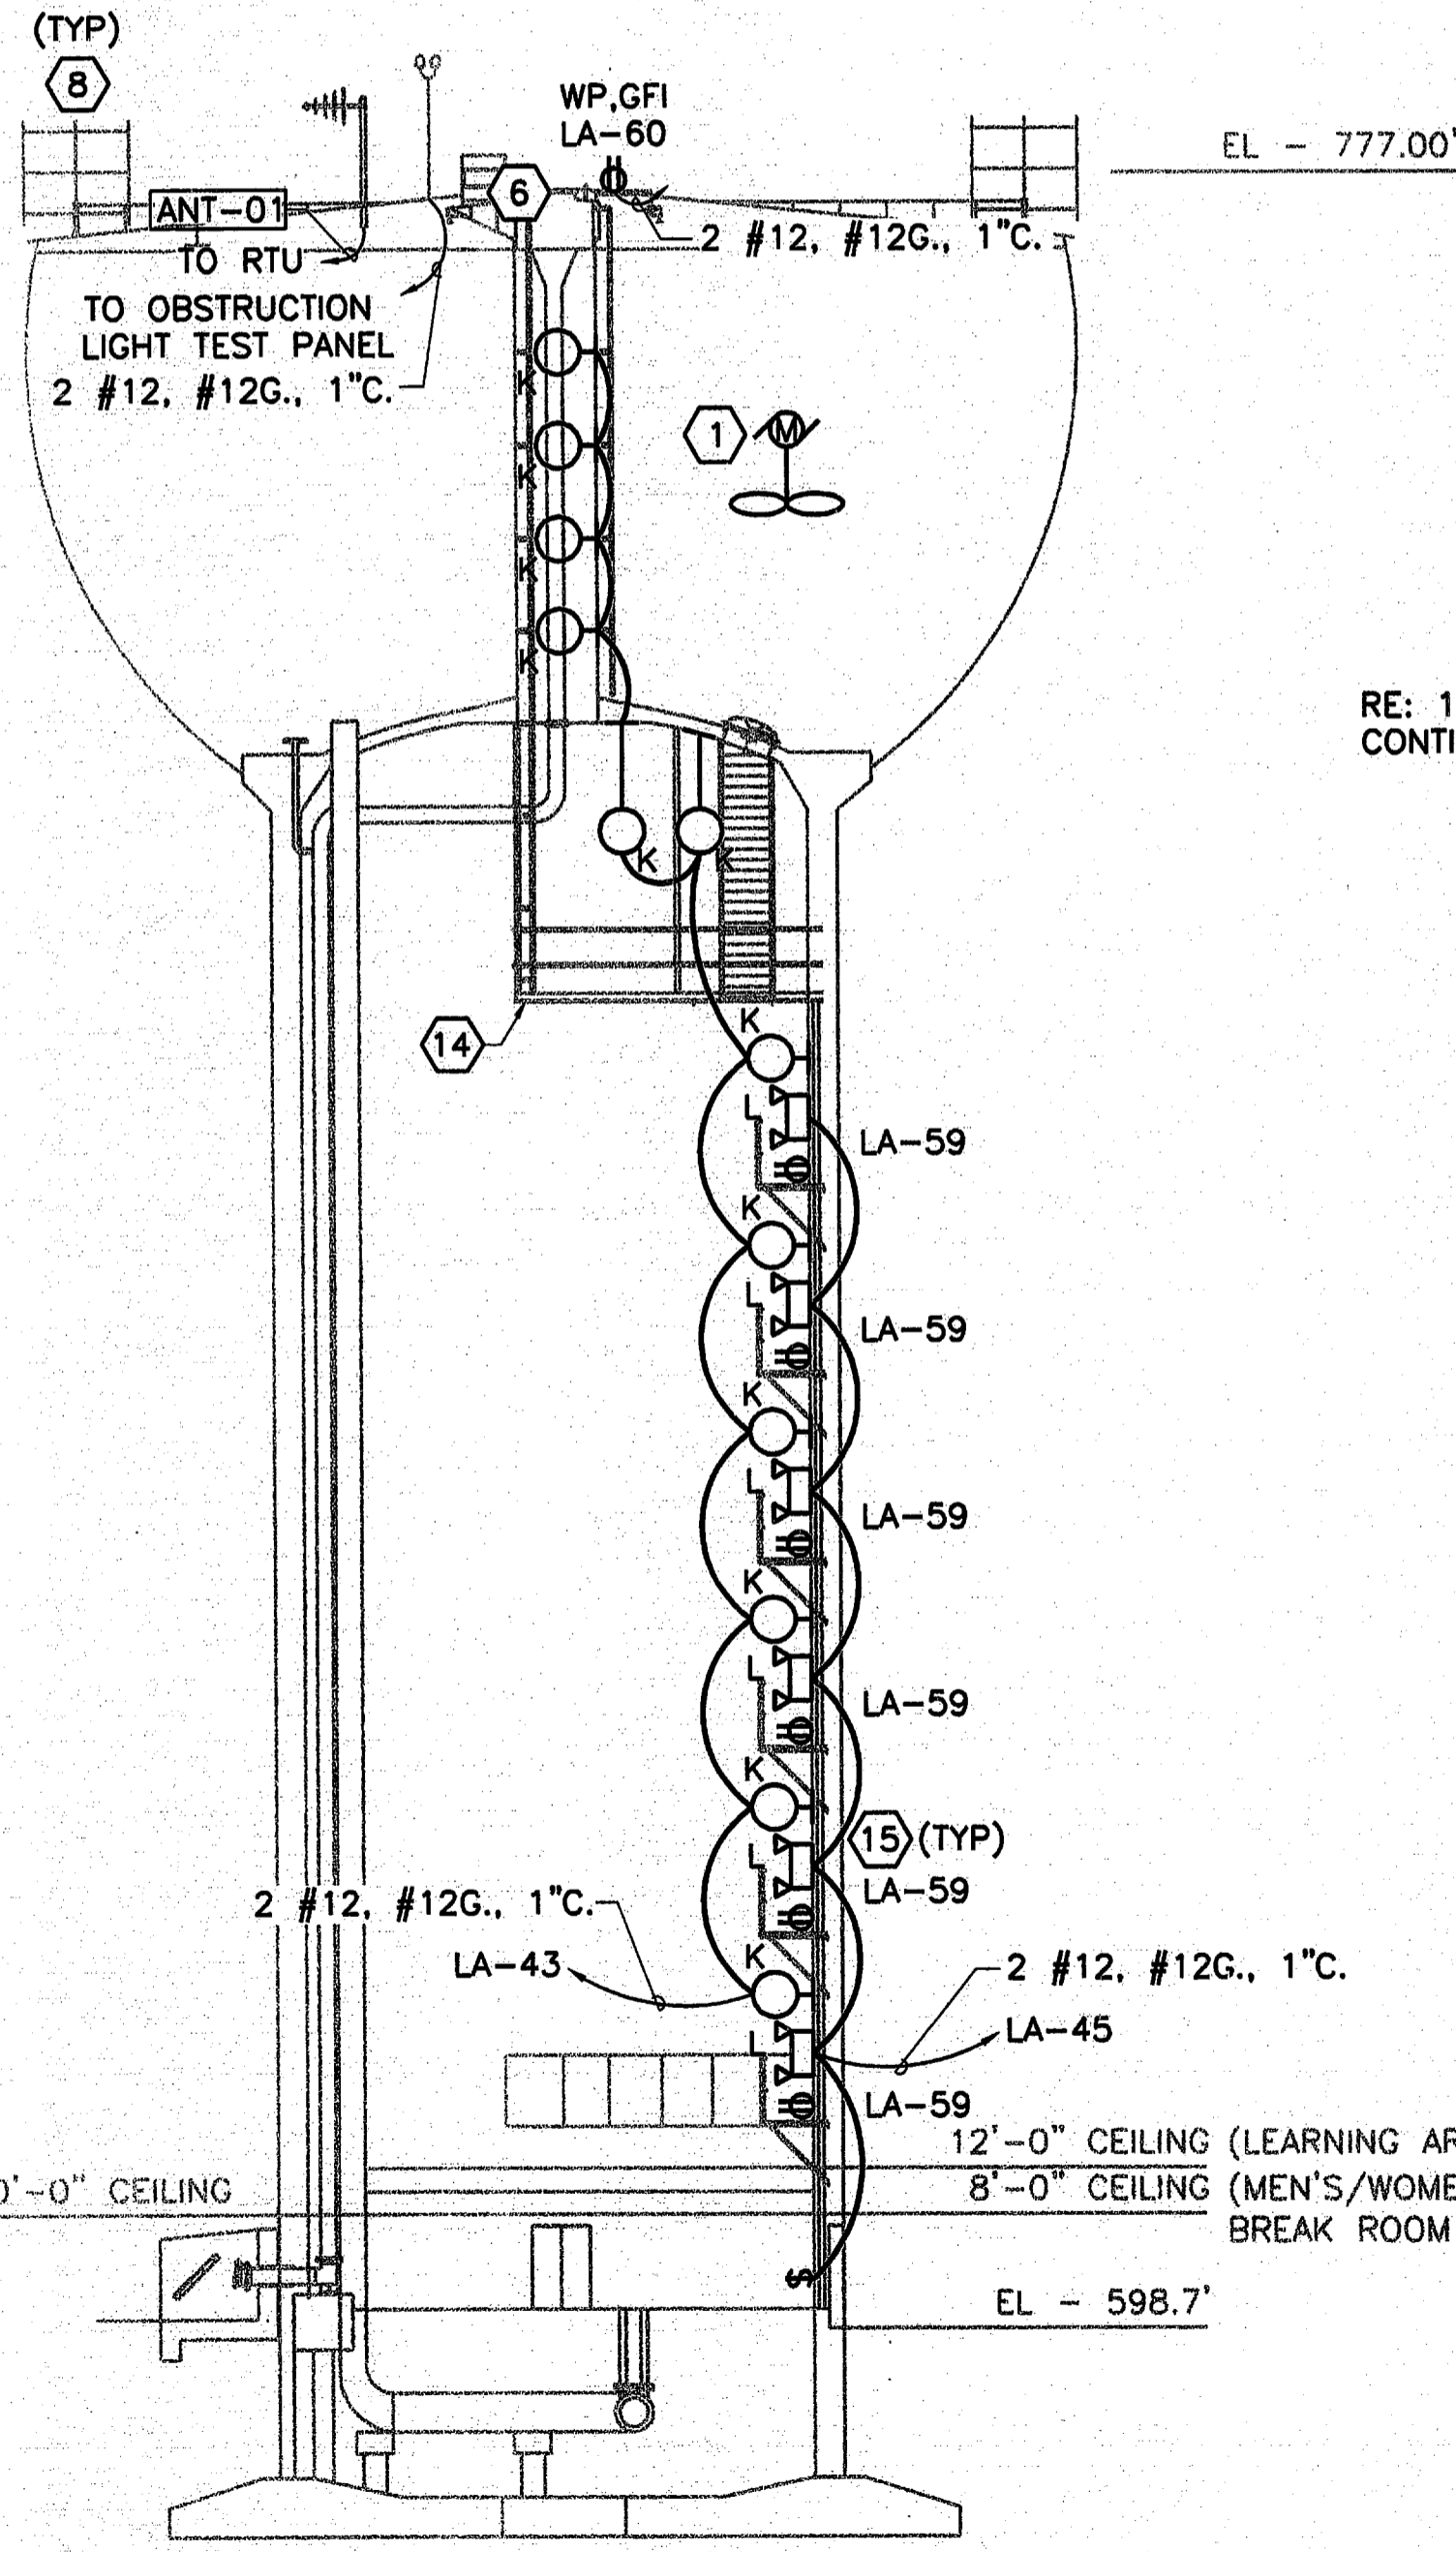


1 TANK ELEVATION
1/16" = 1' = 0"

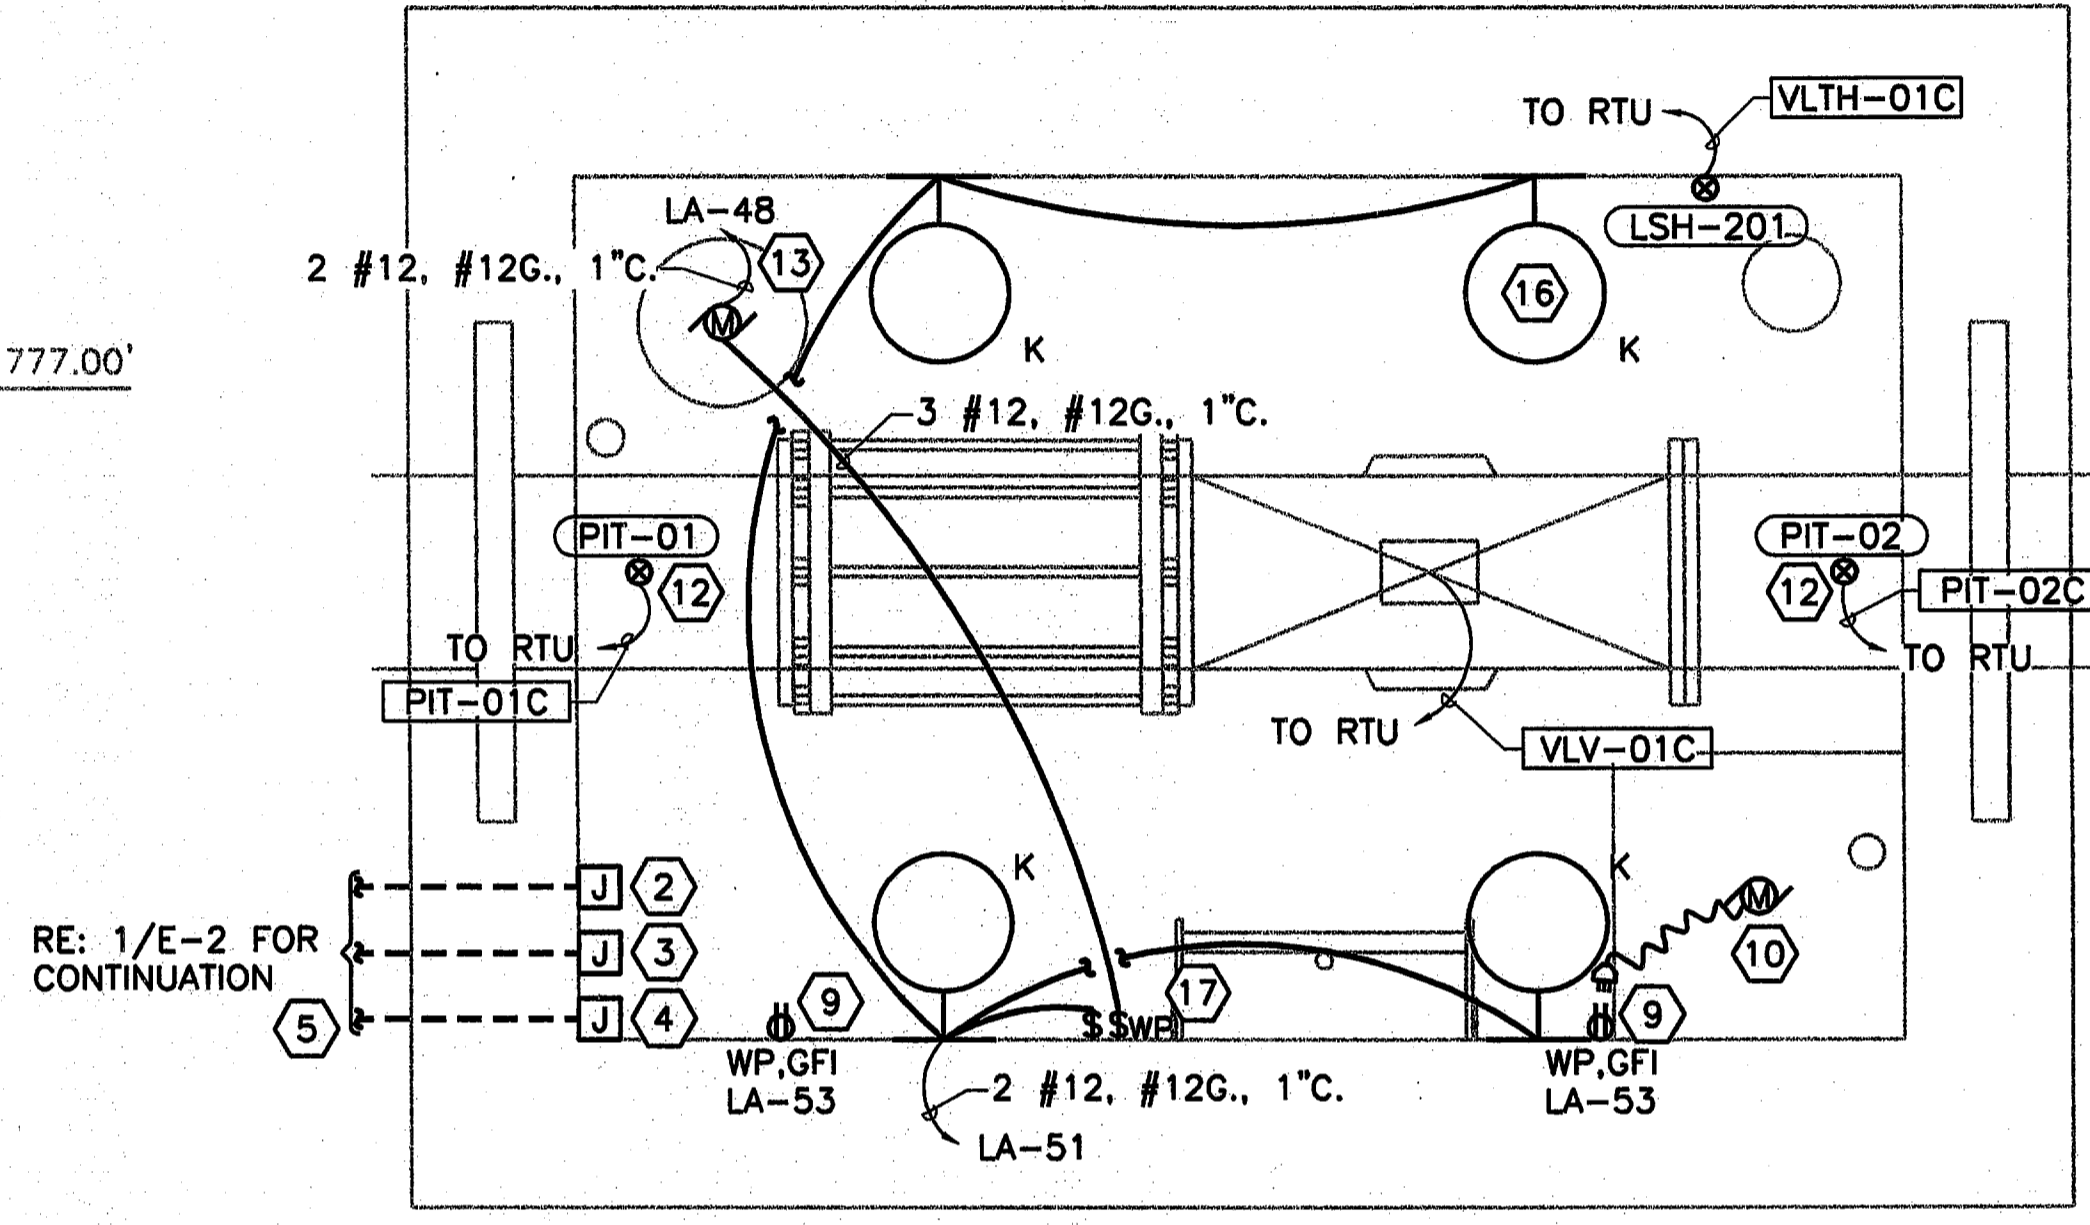


2 VALVE VAULT
3/4" = 1' = 0"

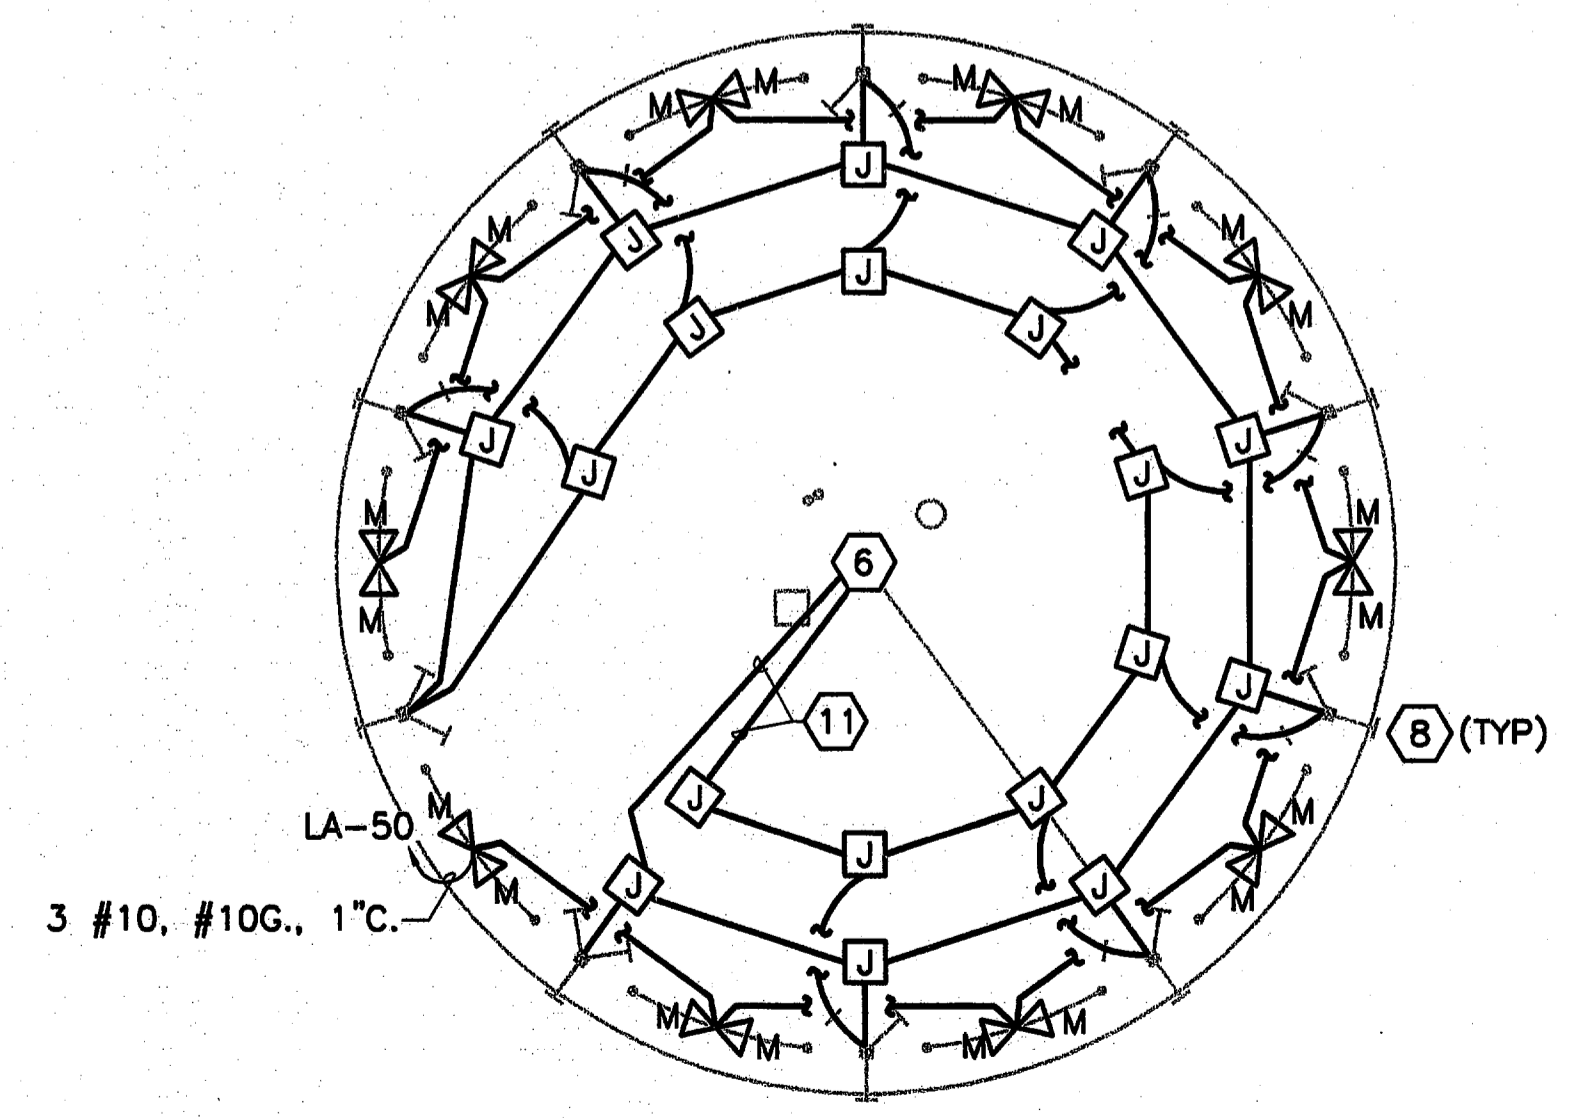


3 ROOF LIGHTING & TURBINE PLAN
1/16" = 1' = 0"

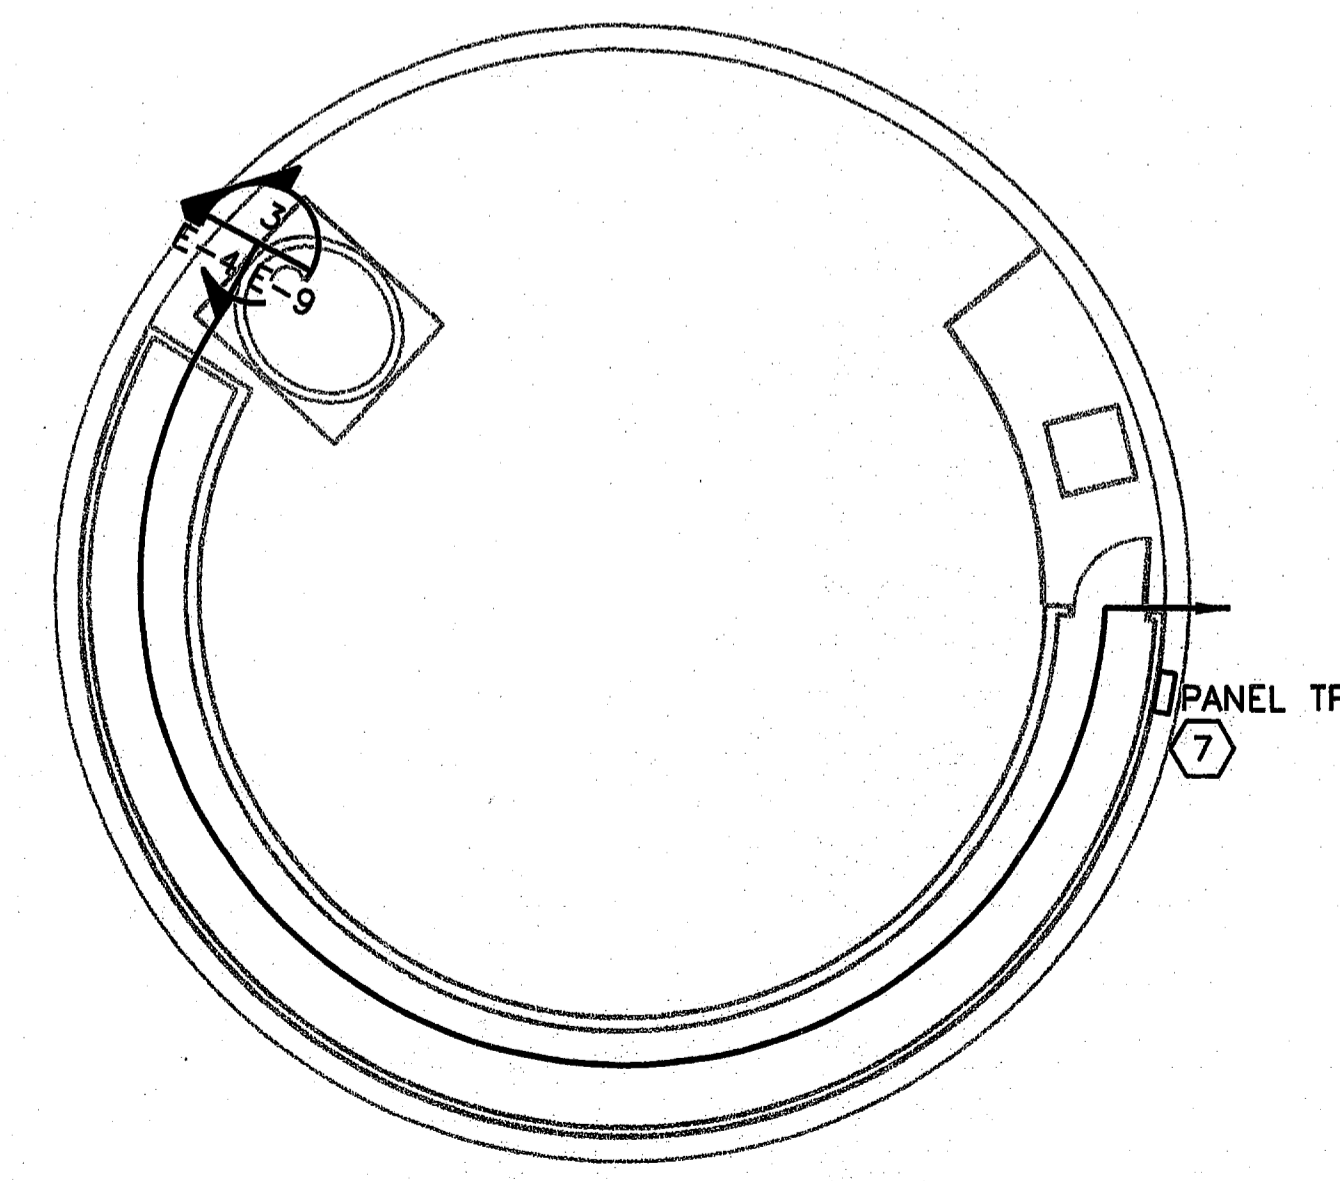

4 PARTIAL RING BALCONY & RAIL DETAIL
1/8" = 1' = 0"

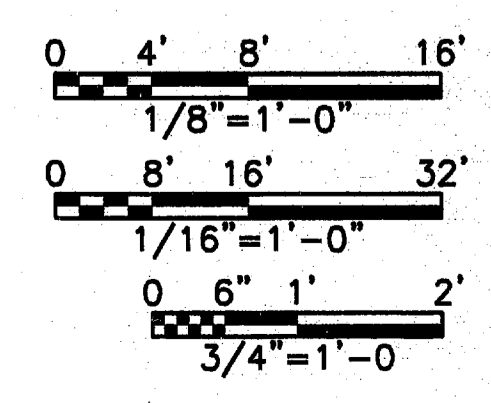

Freese and Nichols, Inc.
 Texas Registered Engineering Firm F-2144

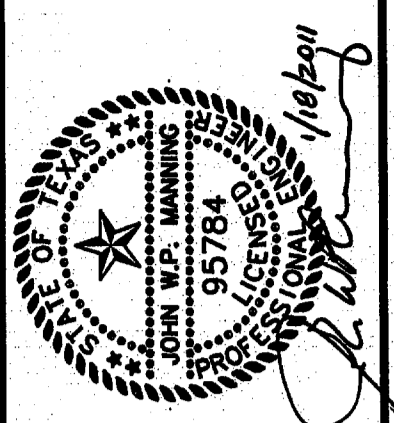

FRESE & NICHOLS
 2220 San Jacinto Blvd., Suite 330
 Denton, Texas 76205-7589
 Phone - (940) 397-4600
 Fax - (940) 397-4677

TOWN OF ADDISON, TEXAS
 SURVEYOR 1.5 MG EST
 ELECTRICAL
 TANK ELEVATION &
 FLOW CONTROL VALVE VAULT

NO.	ISSUE	DATE	BY	DATE	JOB NO.	FILE NAME
0					ADD08459	EL-ADD-PL-ELEV.dwg
1		01/18/11	JWM			
2			JAF			
3			JNH			

Bar is one inch on original drawing. If not one inch on this sheet, adjust scale.

VERIFY SCALE

SHEET **E-4**

SEQ.