




ACAD: Rel 18.0s (LWS Tech) User: jwm  
 [ADD08459] [DINSRV2] N:\elec\EL-ADD-DT-MISC02.dwg LAYOUT: EL-ADD-DT-MISC02.dwg  
 Jan 18, 2011 - 6:35pm LTS: 1 PSLTS: 1 TWIST: CLUAL\FREESE.COM  
 REFERENCES: N:\elec\Bose\JWM-STAMP.dwg, N:\Standard\34BORDER.DWG, N:\F\Bose\cv-util-pl-inverter.dwg, 95784.dwg

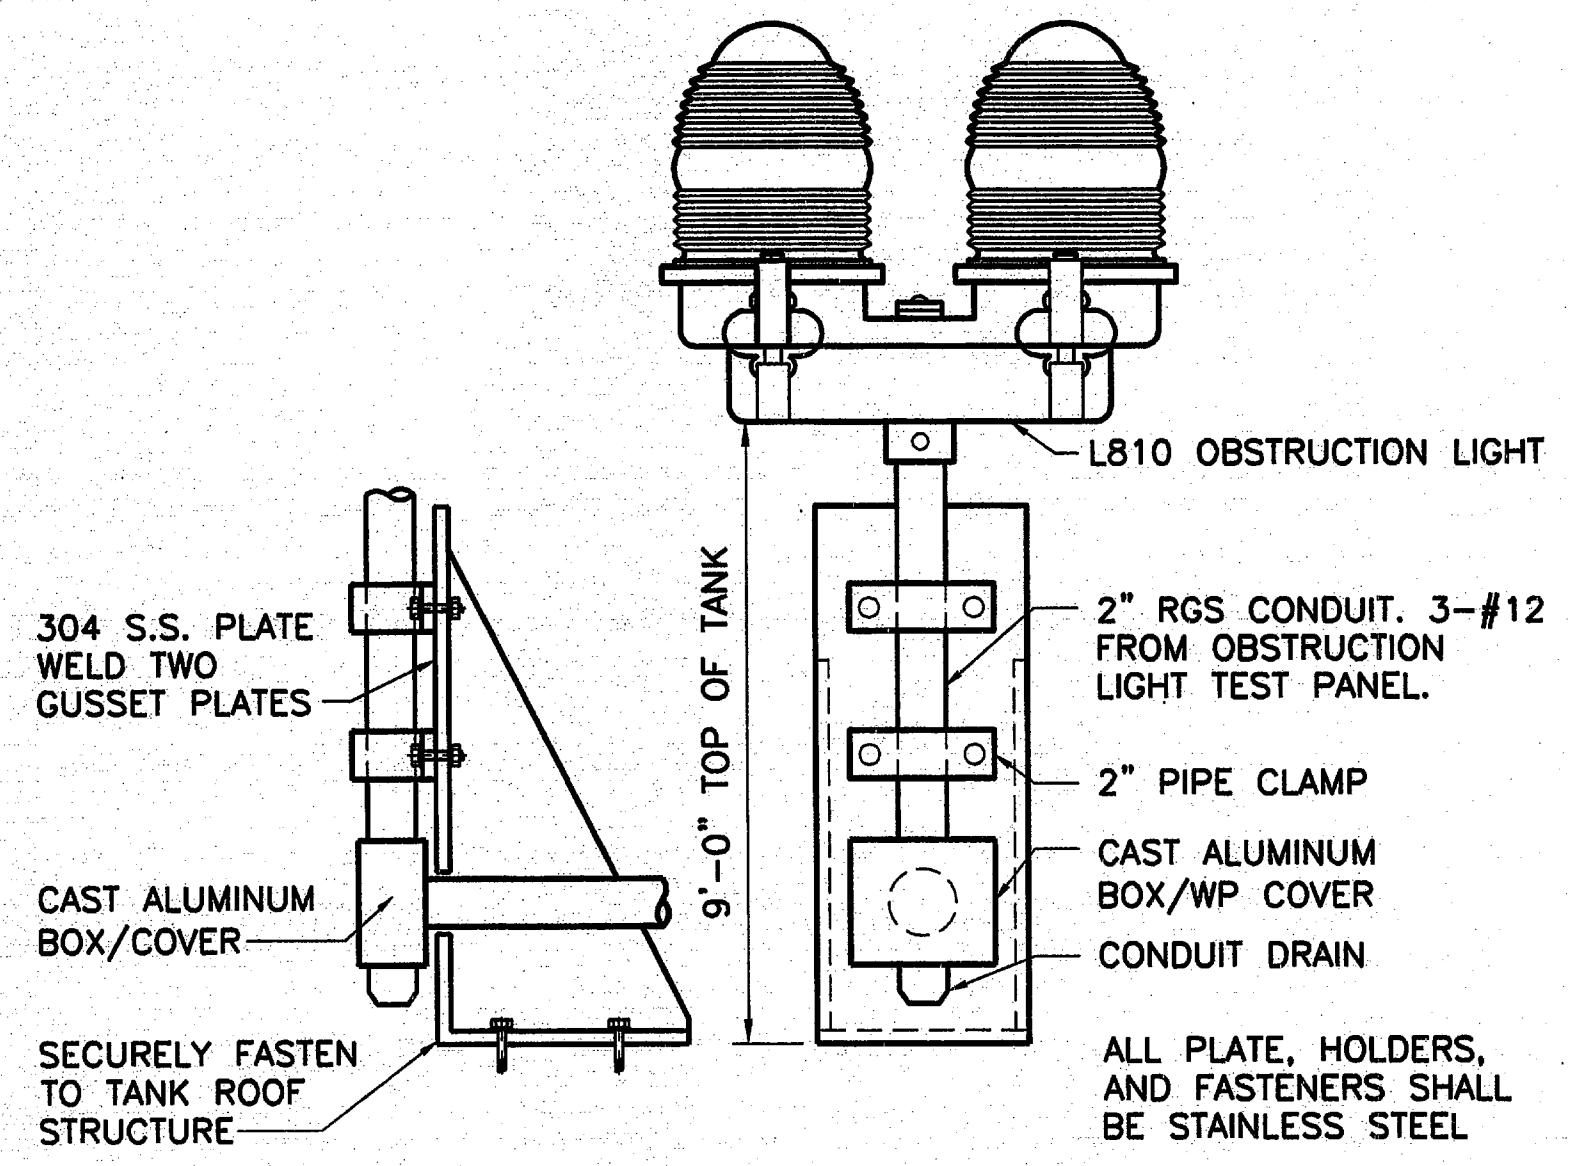

1 OBSTRUCTION LIGHT  
 NOT TO SCALE

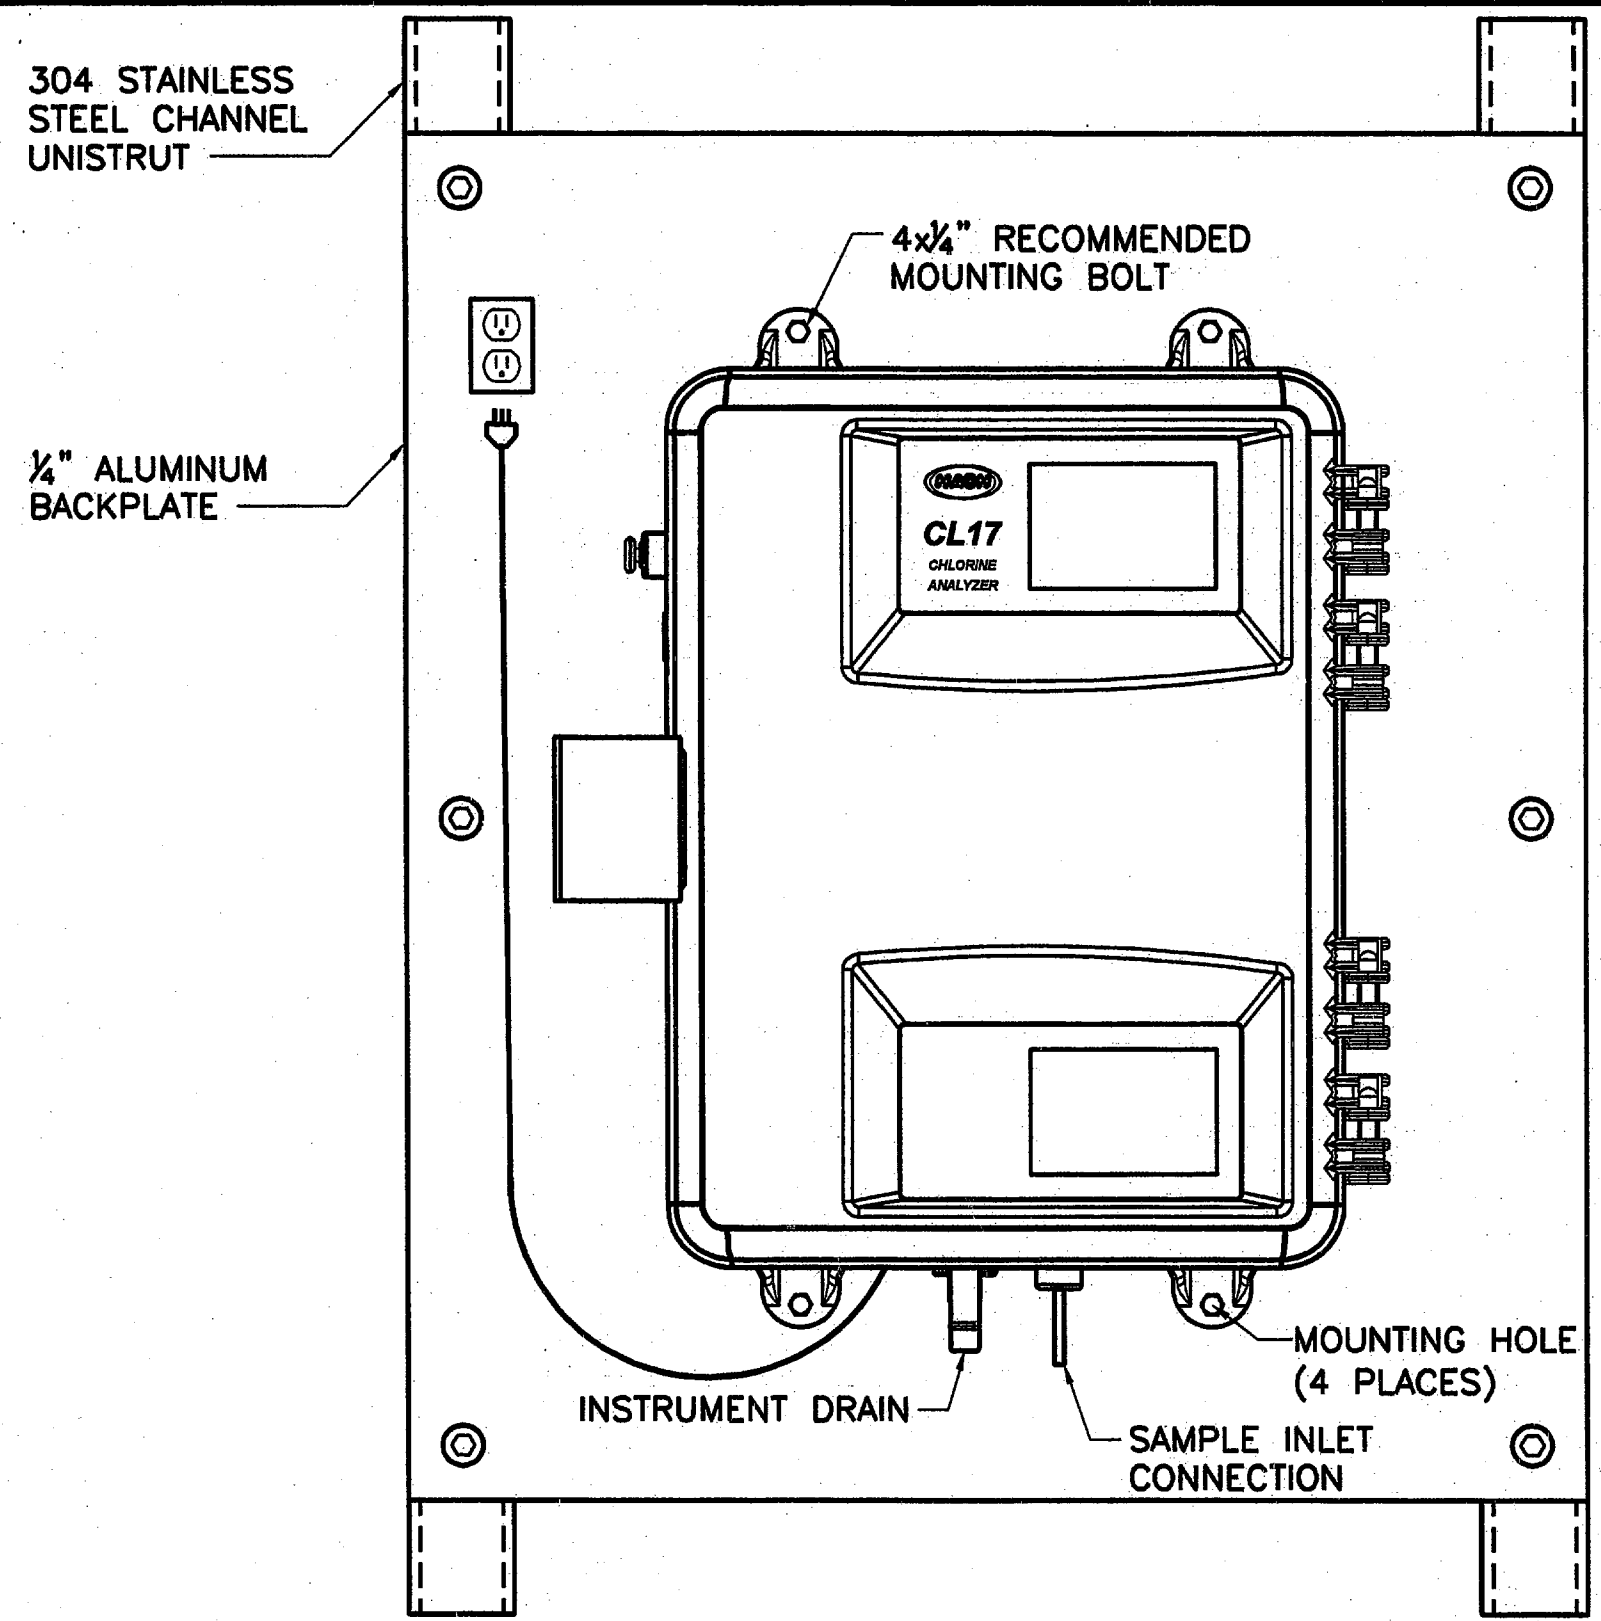

2 CHLORINE MONITOR MOUNTING DETAIL  
 NOT TO SCALE

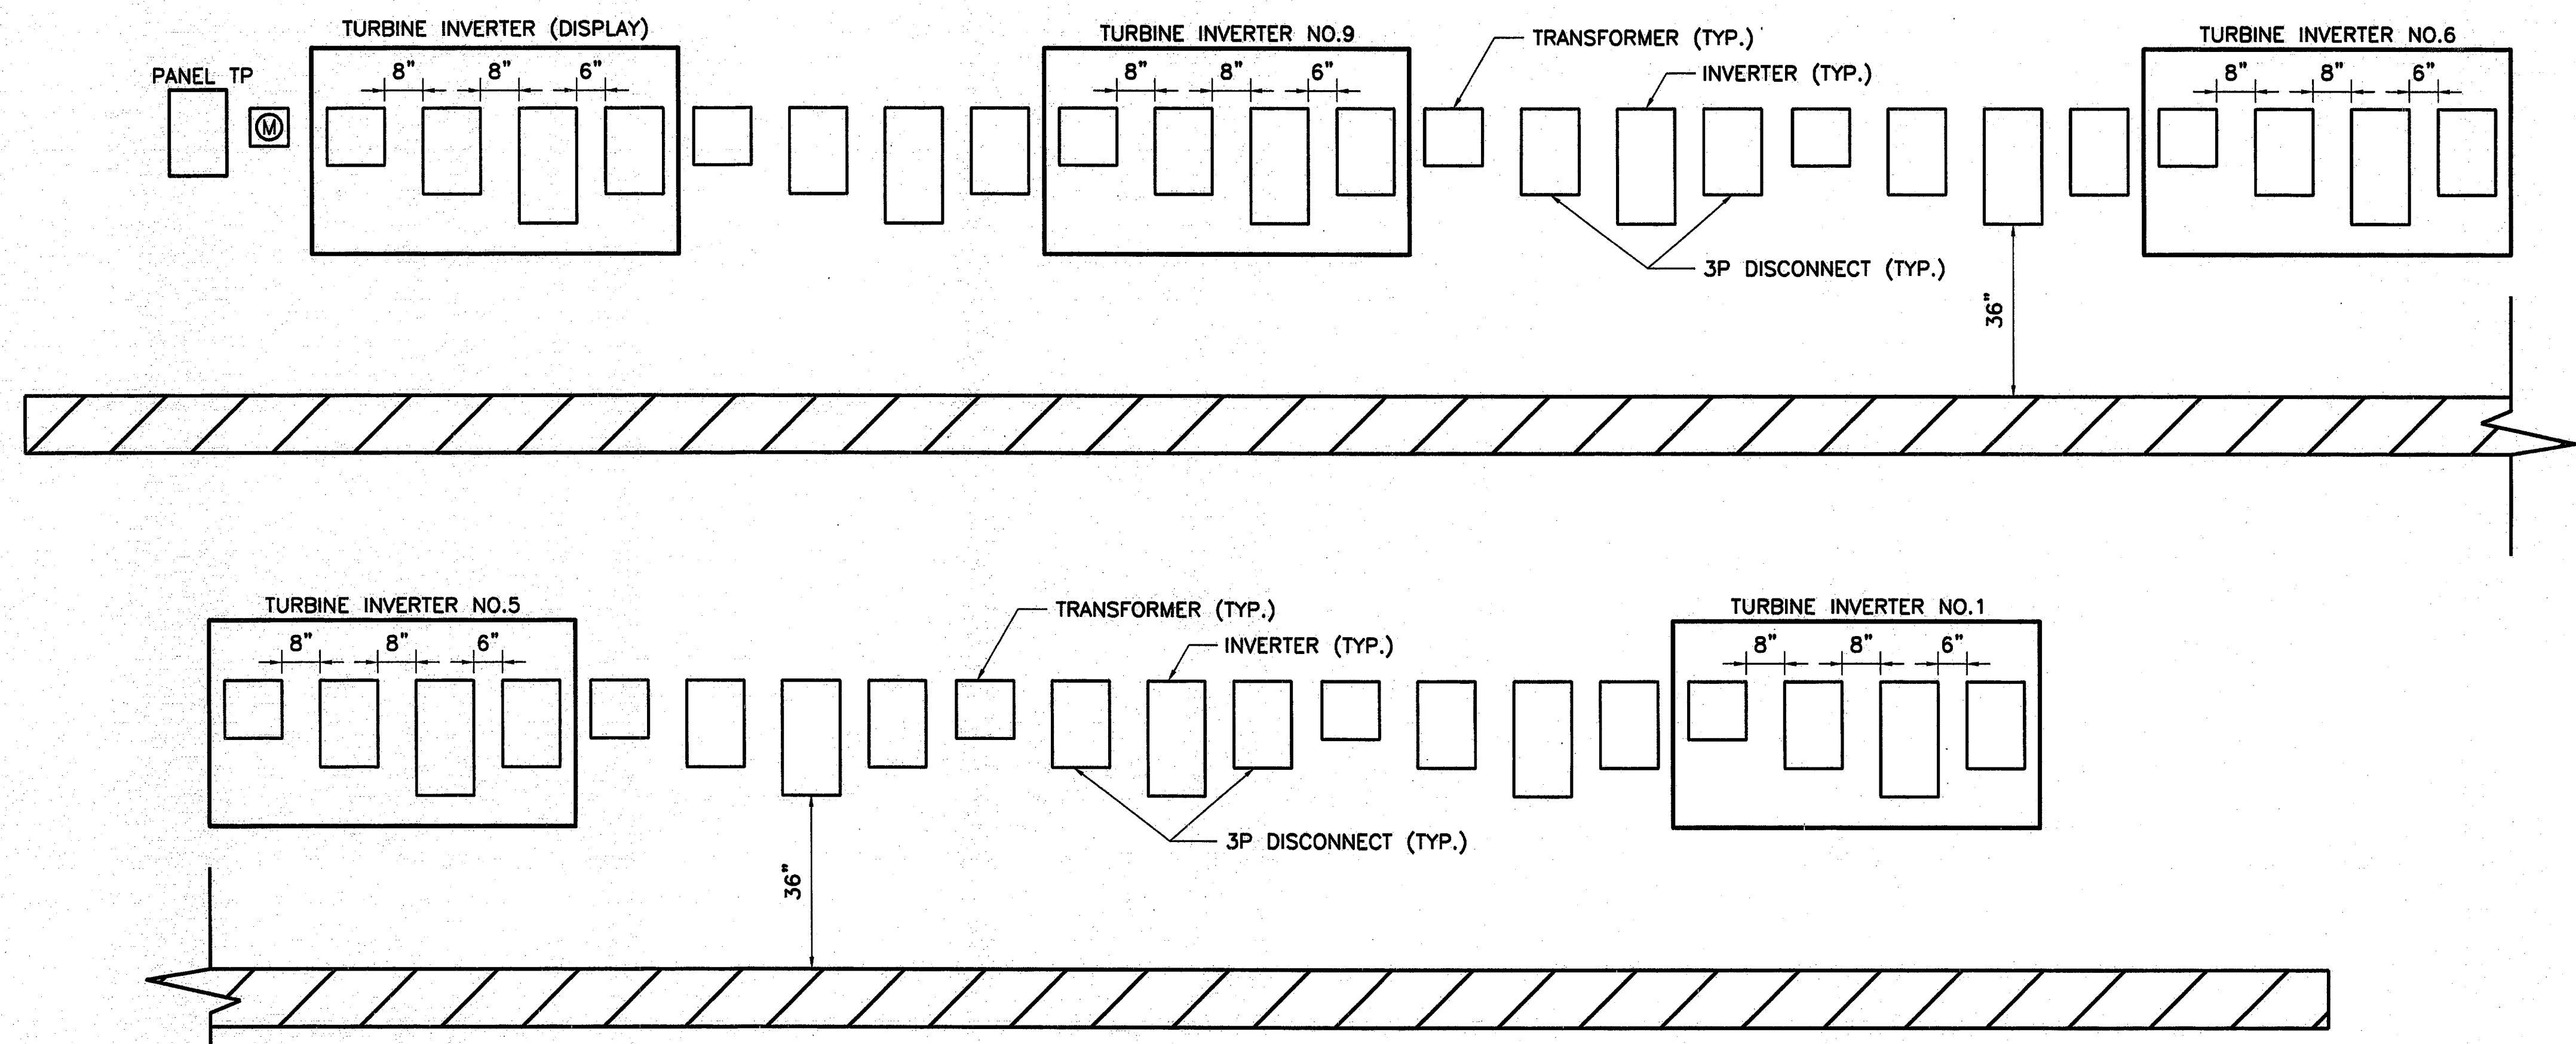

3 WIND TURBINE SYSTEM WALL EQUIPMENT LAYOUT  
 NOT TO SCALE

Freeze and Nichols, Inc.  
 Texas Registered Engineering Firm E-2144  
 JOHN W.P. MANNING  
 95784  
 LICENSED PROFESSIONAL ENGINEER

**FREESE & NICHOLS**  
 2220 San Jacinto Blvd., Suite 330  
 Denton, Texas 76205-7569  
 Phone - (940) 387-4600  
 Fax - (940) 387-4677

TOWN OF ADDISON, TEXAS  
**SURVEYOR 1.5 MG EST**  
 ELECTRICAL  
**DETAILS**

NO.	ISSUE	BY	DATE	FOR JOB NO.	ADD08459
			01/18/11	DESIGNED	JWM
				DRAWN	JAF
				REVISED	
				CHECKED	JNH
				FILE NAME	EL-ADD-DT-MISC02.dwg

VERIFY SCALE: Bar is one inch on original drawing, if not one inch on this sheet, adjust scale.

SHEET **F-9**

SEQ.