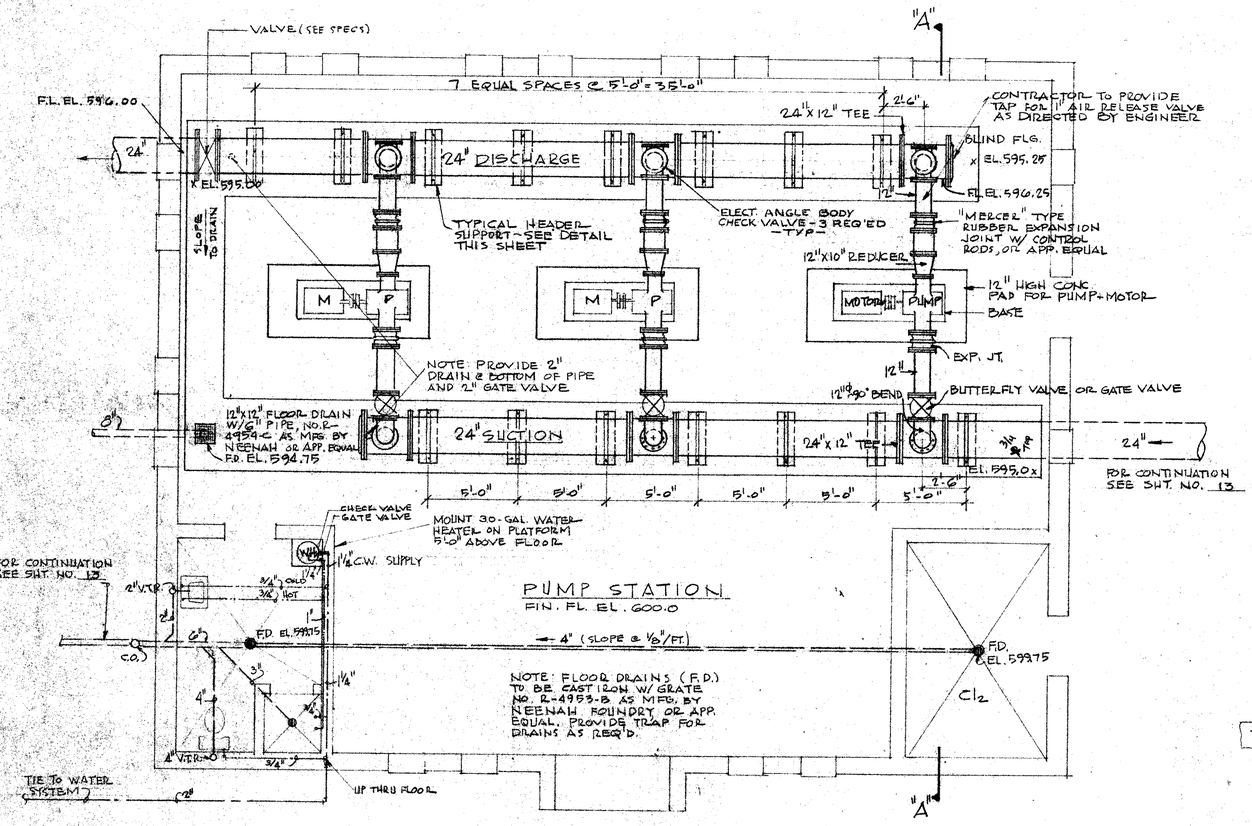

NOTE: ON VENTS THRU ROOF (V.T.R.) OFFSET AS REQ'D. - CO-ORD. W/ ROOF JOISTS AND CONC. FASCIA.

PUMP STATION PIPING PLAN

SCALE: 1/4" = 1'-0"

NORTH

NOTE: DUCTILE IRON PIPE SHALL BE USED THRU WALLS AND INSIDE PUMP STATION. NO SUBSTITUTION WILL BE ALLOWED. VALVES MAY BE GATE OR BUTERFLY UNLESS SPECIFICALLY DESIGNATED.

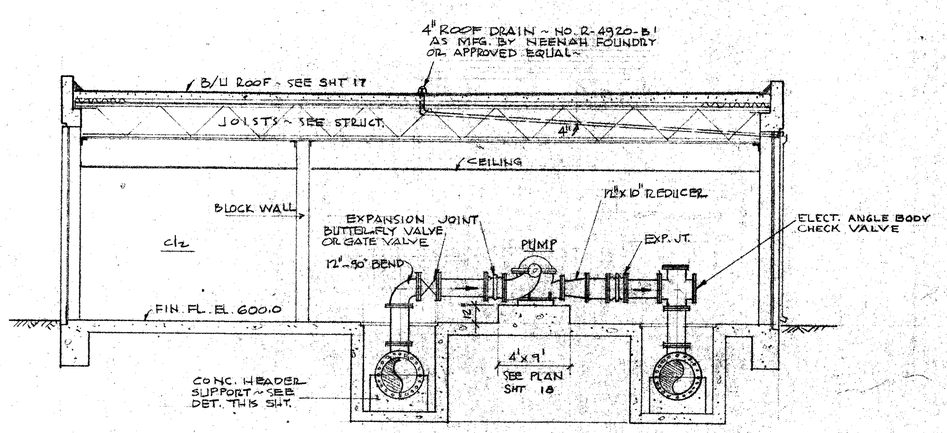

SECTION A-A

SCALE: 1/4" = 1'-0"

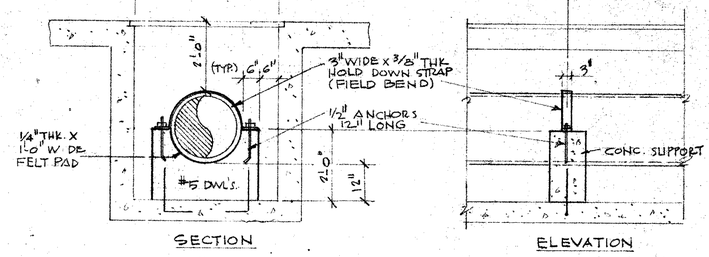

TYPICAL HEADER PIPE SUPPORT

SCALE: ½" = 1'-0"

STATE OF TEXAS — H. WAYNE GINN — 3112 — REGISTERED PROFESSIONAL ENGINEER

CITY OF ADDISON
DALLAS COUNTY, TEXAS

WATER PUMP STATION AND WATER MAINS

PUMP STATION PIPING PLAN

GINN & STACY, INC.
CONSULTING ENGINEERS — DALLAS, TEXAS

DESIGNED BY: HWG	SCALE: AS SHOWN	Sheet 14 of 24
DRAWN BY: GF	DATE: AUG. 77	