
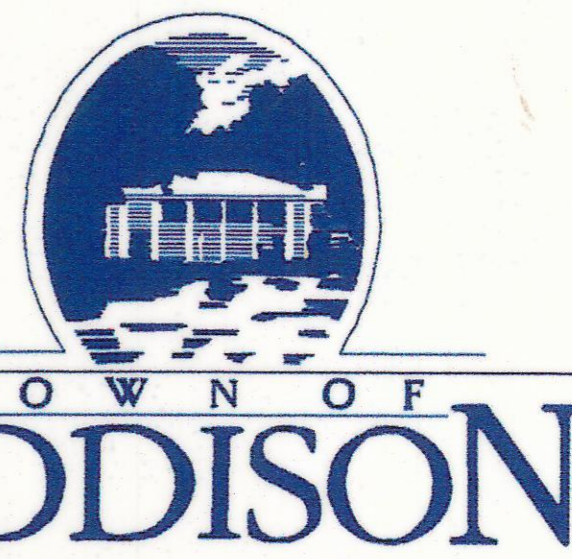


BASIN	PEAK DAILY FLOW
A	1.24 M.G.D.
B	2.45 M.G.D.
C	1.97 M.G.D.
D1	2.04 M.G.D.
D2	1.02 M.G.D.
D3	1.02 M.G.D.
E	1.56 M.G.D.
F	1.51 M.G.D.
G1	0.67 M.G.D.
G2	1.21 M.G.D.
H	1.27 M.G.D.
I	0.43 M.G.D.
J	0.17 M.G.D.
K	1.05 M.G.D.

LEGEND

- EXISTING SANITARY SEWER MANHOLE
- EXISTING SANITARY SEWER LINE
- MAJOR BASIN DIVIDE BOUNDARY
- SUB BASIN DIVIDE BOUNDARY
- METERING STATION
- BASIN DESIGNATION
- REPLACE SEGMENT DUE TO CAPACITY-CATEGORY 1
- REPLACE SEGMENT DUE TO CAPACITY-CATEGORY 2
- LINE BEING ABANDONED

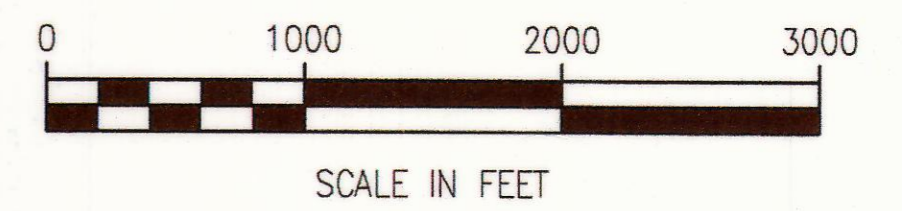

SANITARY SEWER MAP
LINES IDENTIFIED AS UNDER CAPACITY

JULY, 1996

SHIMEK, JACOBS & FINKLEA
 CONSULTING ENGINEERS
 Dallas, Texas