


- NOTES: 1. SEWER PIPE TO BE PVC-SDR 35.  
 2. WATER PIPE TO BE PVC-SDR 18.  
 3. CASING PIPE TO BE GALVANIZED CORRUGATED STEEL 16 GAGE AS PER TEXAS HIGHWAY DEPARTMENT SPECIFICATIONS ITEM 450.  
 4. EMBEDMENT FOR SEWER PIPE SHALL BE FULL SAND.


CAUTION: FAA BURIED CABLE  
 CALL 239-5565  
 PRIOR TO ANY DIGGING  
 CONTACT MR. MARTIN OR  
 MR. STRAITON

ESTIMATED QUANTITIES	
10" P.V.C. SEWER DITCH (0'-10')	493 L.F.
MANHOLE (8'-10')	1 EA.
MANHOLE (10'-12')	1 EA.
MANHOLE (12'-14')	1 EA.

PLAN  
 SURVEIL  
 ALIGNMENT CHECKED  
 T. OF WAY CHECKED  
 NO.

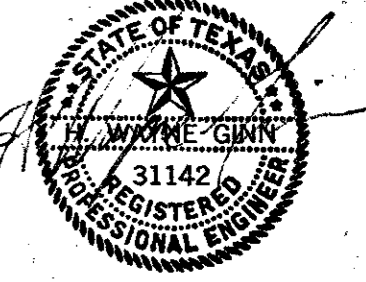

CITY OF ADDISON  
 DALLAS COUNTY, TEXAS  
 AIRPORT SEWER  
 PLAN AND PROFILE  
 STA. 0+00 TO STA. 833.32  
 GINN & STACY, INC.  
 CONSULTING ENGINEERS - DALLAS, TEXAS  
 DESIGNED BY HWG [SCALE] AS SHOWN  
 DRAWN BY GLH [SCALE] APRIL, 1978

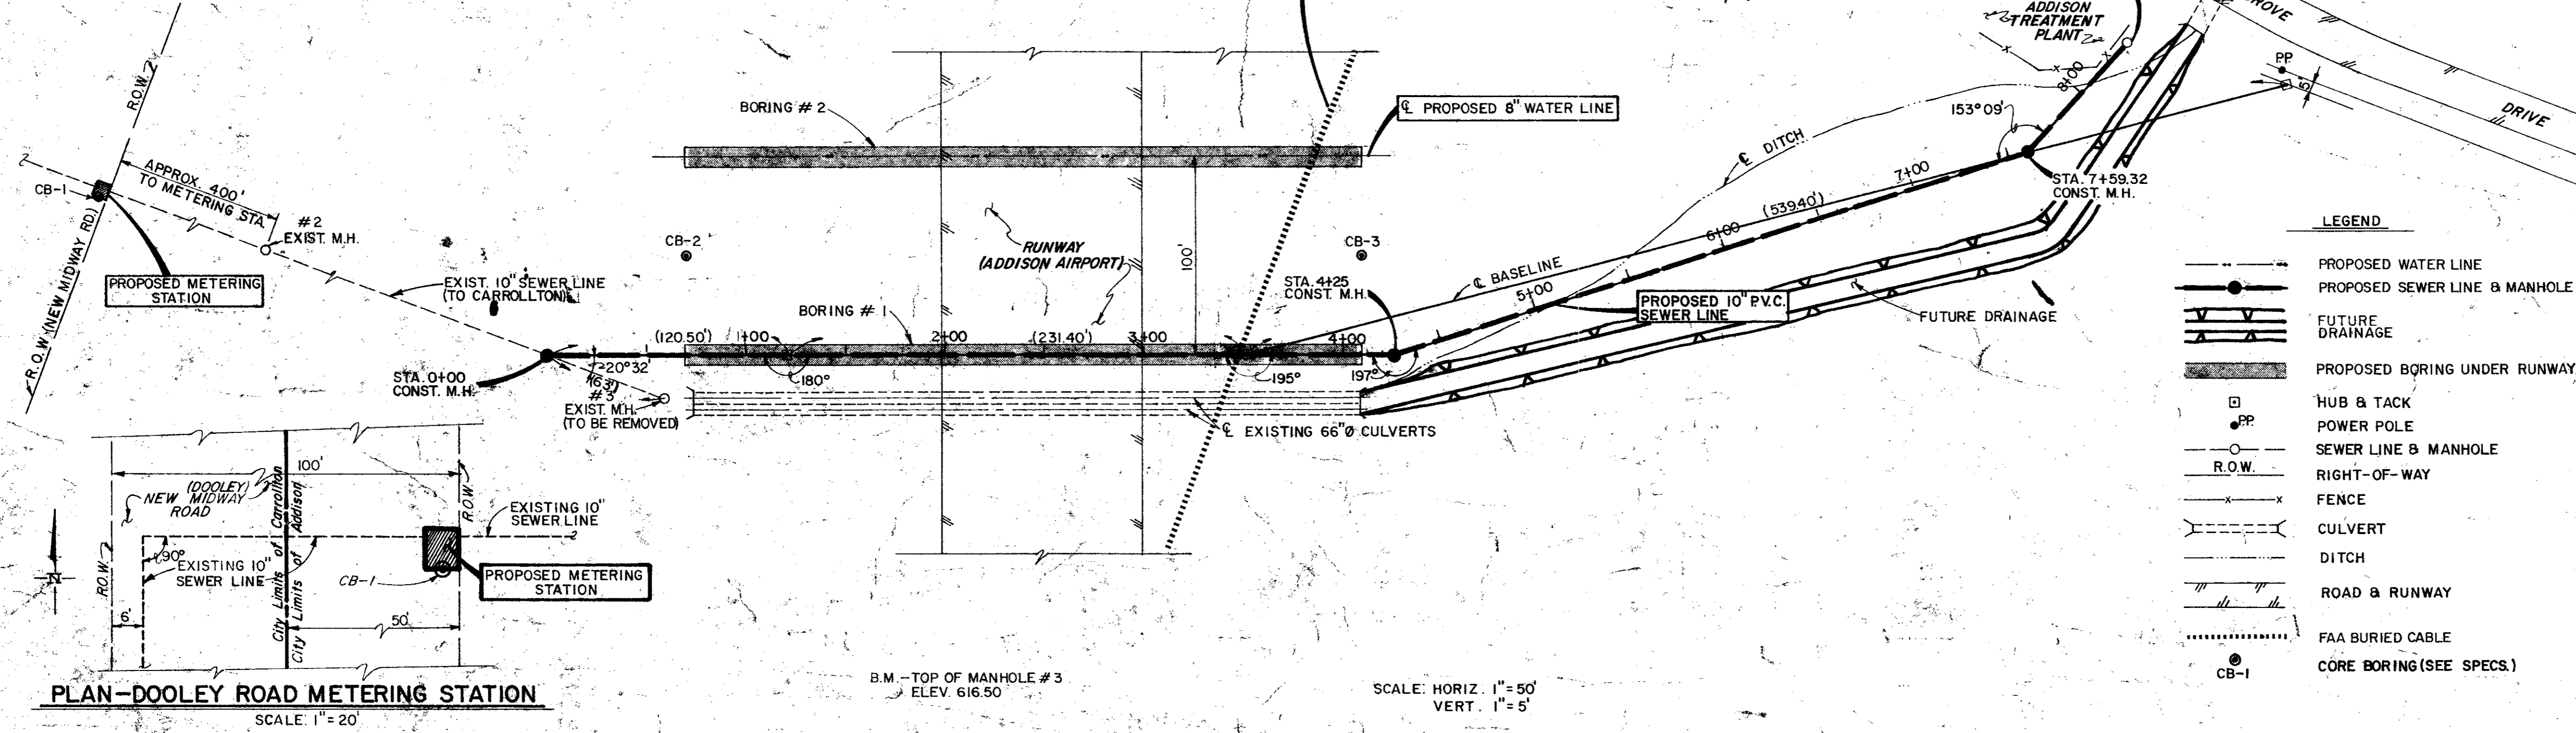

PLAN-DOOLEY ROAD METERING STATION  
 SCALE 1"=20'

B.M. - TOP OF MANHOLE #3  
 ELEV. 616.50

SCALE: HORIZ. 1"=50'  
 VERT. 1"=5'

PROFILE  
 SURVEIL  
 GRADES CHECKED  
 B.M.'S NOTED  
 EMBLEMIC INSTALLATIONS CHECKED  
 NO.

