



Design By: *R.H. Zellars* Date: *1-24-82*
 ROW Approved: _____ Date: _____
 Engineer Of Design - Water Utilities Dept. Date: _____
 Contract No.: _____





GENERAL NOTES:

- All water mains shall be Ductile Iron Class 51 water pipe with Polyethylene wrap on pipe, fittings, and fire hydrant bases.
- Alternate - all 6" and 8" water mains shall be P.V.C. Class 200 water pipe except in fill areas and major and secondary thoroughfares for P.V.C. Service taps 1" and larger, tapping saddle shall be used.
- All water mains shall have a minimum cover below finish grades as follows: 6" - 48", 12" - 60", or as required to clear other utilities.
- All water services shall be located as shown: all single deadheads are 1" copper.
- All sanitary sewer lateral's shall be 6" and located as shown.
- All pavement within the limits of this project is proposed.
- Water services to existing water main shall be installed by the Contractor.

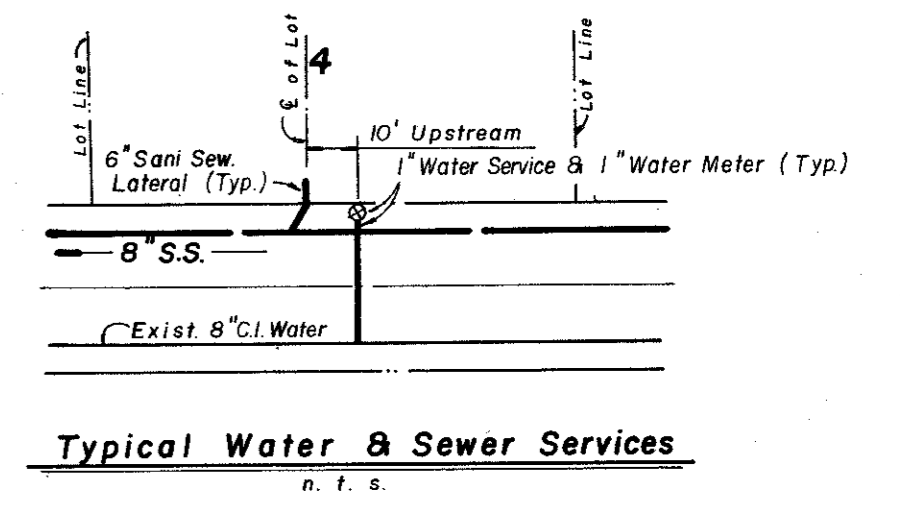

WILLARD BAKER & LAVERE BROOKS
 BLK N° 8172

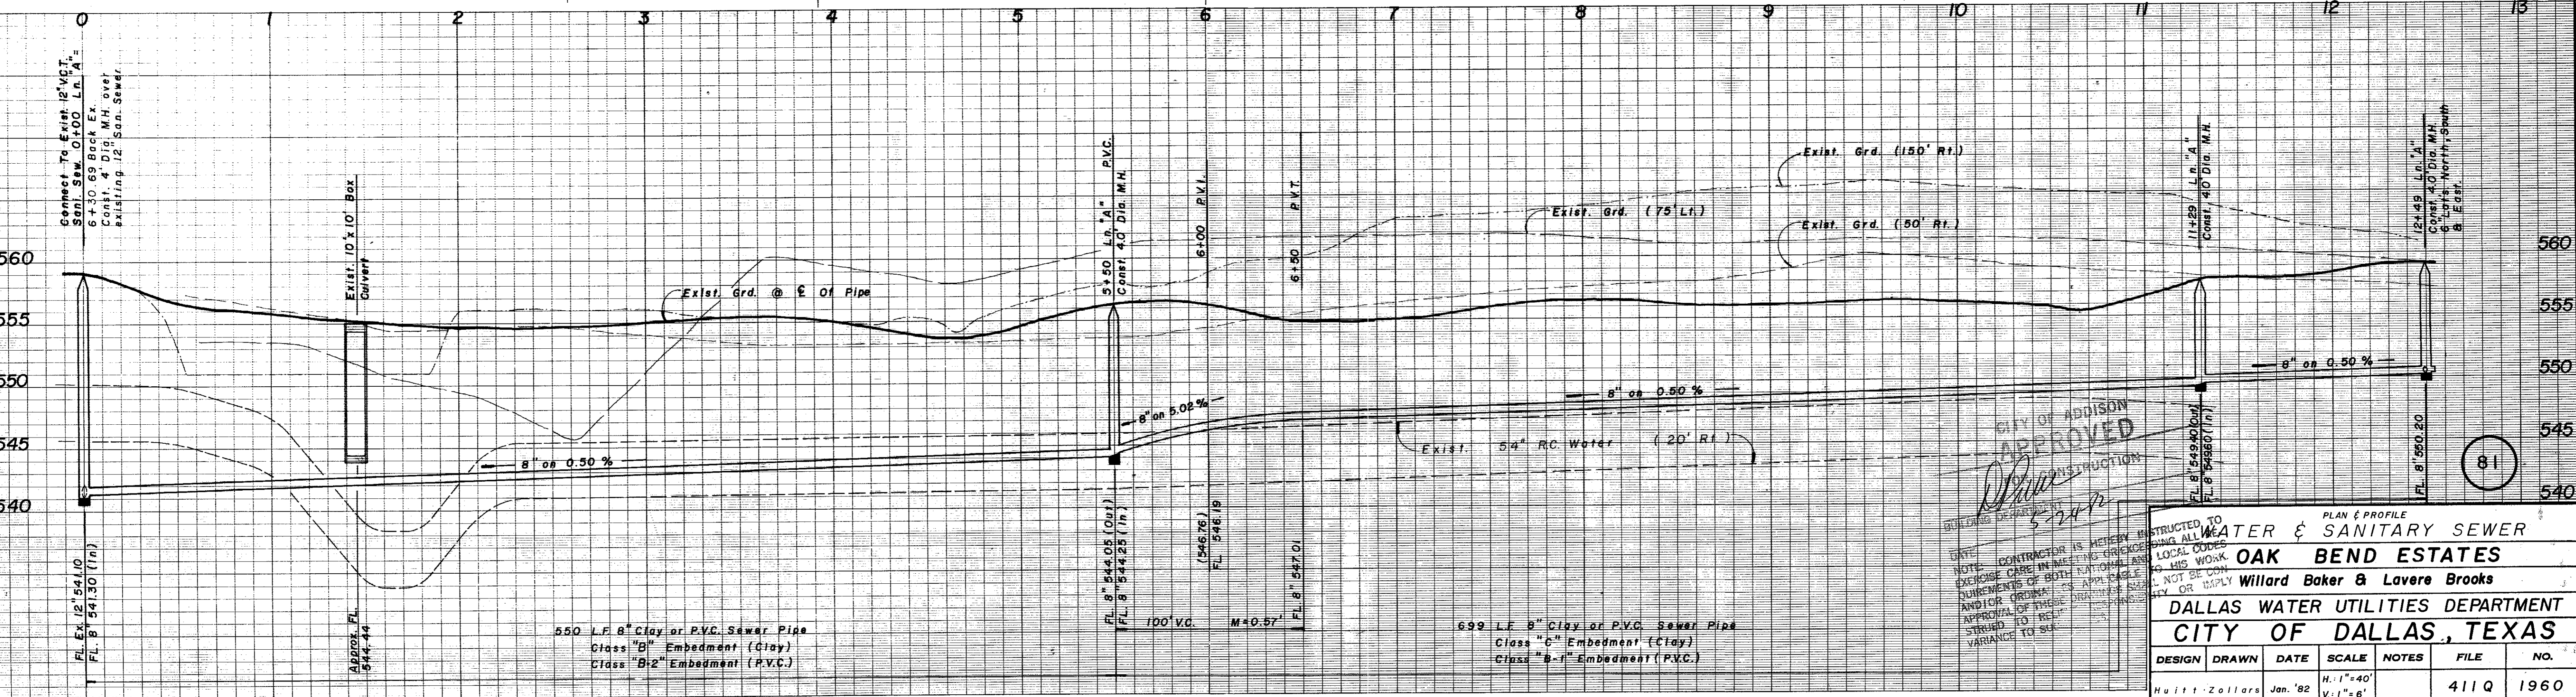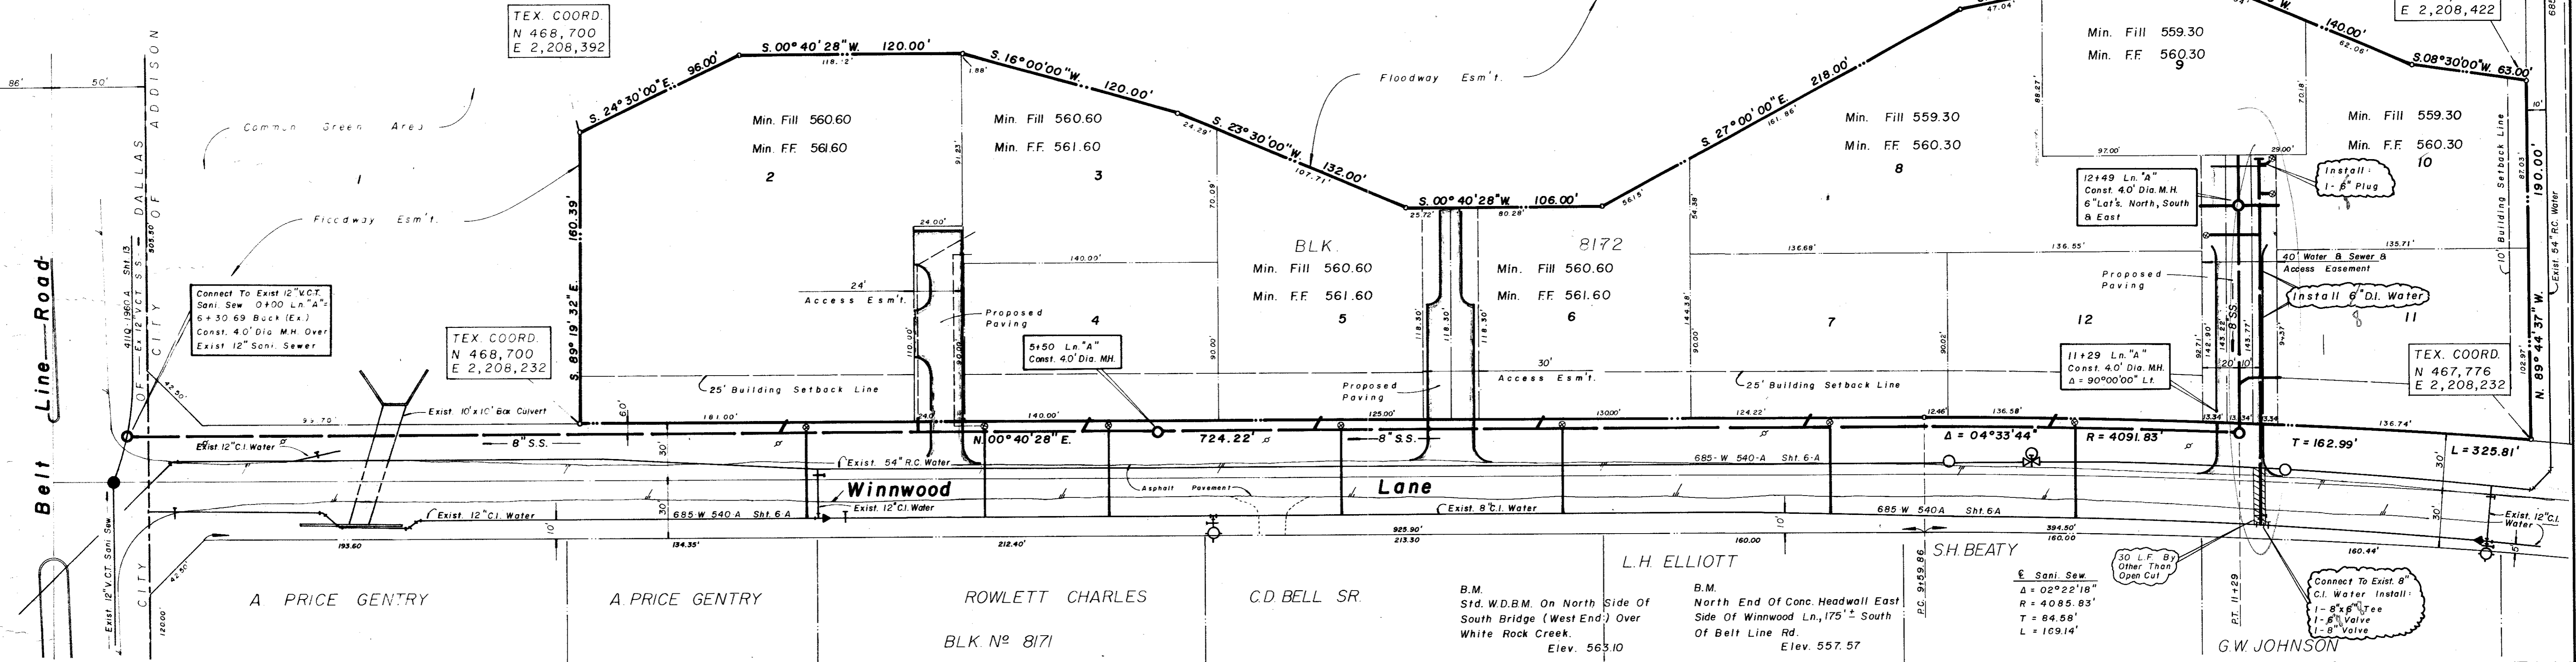

CITY OF ADDISON
 APPROVED
 5-24-82

DESIGN		DRAWN		DATE	SCALE	NOTES	FILE	NO.
Huitt-Zellars		Jan. '82		H: 1"=40'	V: 1"=6'		411 Q	1960