

24. ALL WATER METERS SHALL HAVE A BACKFLOW PREVENTION ASSEMBLY INSTALLED ON THE PROPERTY OWNER SIDE OF THE WATER METER. ALL BACKFLOW PREVENTION ASSEMBLIES SHALL BE USC CERTIFIED.

(NO SEPARATE PAY ITEM).

25. CONSTRUCTION STAKING SHALL BE SUBSIDIARY TO THE WATERLINE CONSTRUCTION.

26. ALL BARRICADES AND SIGNS SHALL BE PLACED WITH THE TOWN OF ADDISON'S APPROVAL PRIOR TO PLACEMENT. Submit plan for approval.

27. BEFORE THE NEWLY CONSTRUCTED WATER MAIN IS PERMITTED TO BE PLACED INTO SERVICE, IT SHALL BE PRESSURE TESTED, DISINFECTED AND TESTED FOR BACTERIA AT THE CONTRACTOR'S EXPENSE. TESTING IS TO BE ACCOMPLISHED

28. STAGING AND STORAGE FOR THIS PROJECT SHALL BE APPROVED BY THE TOWN OF ADDISON PRIOR TO ANY CONSTRUCTION ACTIVITY. AT NO TIME WILL PUBLIC

30. CONTRACTOR SHALL VIDEO TAPE THE SITE IN IT'S ENTIRETY PRIOR TO ANY CONSTRUCTION. (NO SEPARATE PAY ITEM)

31. CONTRACTOR SHALL SUPPLY ASBUILT DRAWINGS TO THE

TOWN OF ADDISON. DIMENSIONS AND LENGTH OF PIPE FROM

RIGHT-OF-WAY BE USED FOR STAGING OR STORAGE.

BENDS AND VALVES SHALL BE LISTED.

BY A TOWN OF ADDISON APPROVED LAB. NO ADDITIONAL COMPENSATION WILL BE ALLOWED FOR DISINFECTION AND TESTING.

29. ALL NEW DUMMY AND EXPANSION JOINTS SHALL MATCH EXISTING JOINT LOCATIONS

comply with TMUTCD Part VI latest revision.

WASHED PEA GRAVEL CORPORATION STOP WITH CONDUCTIVE COMPRESSION COUPLING NUT TYPE "K" COPPER SERVICE LINE WITH 8 MIL POLY WRAP. NO COUPLING ALLOWED UNLESS SERVICE LINE EXCEEDS 20'. WATER SERVICES SHALL NOT BE CONNECTED TO FIRE HYDRANT LINES. ALL MATERIALS SHALL CONFORM TO THE STANDARD SPECIFICATIONS AND/OR SPECIAL PROVISIONS. TYPICAL SERVICE CONNECTION WITH METER BOX

SUPPL

N GENERAL, ALL FIRE HYDRANTS SHALL CONFORM TO AWWA STANDARD SPECIFICATIONS

FOR FIRE HYDRANTS FOR ORDINARY WATER

WORKS SERVICE FOR WATER AND SANITARY SEWER IMPROVEMENTS, FIRE HYDRANTS WITH A BARREL APPROXIMATELY 7" INSIDE DIAMETER.

ALL HYDRANTS SHALL BE EQUIPPED WITH A

SPECIFICATIONS AND SPECIAL PROVISIONS.

BONNET TO FLANGE AND NOZZLE CAPS COLOR CODE FOR MAIN SIZE ACCORDING TO ALLEN STANDARDS

MAINDER OF HYDRANT ABOVE

24" SQ. VALVE PAD

GROUND PAINTED ALUMINUM

MIN. 7 CUBIC FEET OF

WASHED GRAVEL FILL

CLASS "B" CONCRETE

THRUST BLOCK MUST

NOT BLOCK WEEP HOLE

BREAKAWAY FLANGE. ALL HYDRANTS SHALL BE

APPROVED IN ACCORDANCE WITH THE STANDARD

MIN. 2-0 B.C.

--- 2 - 2 1/2" NOZZLES

" NOZZLE

Sauge Threads

POLYNWRAPOK

/////>
PRECAST CONCRETE SLAB

TYPICAL FIRE HYDRANT INSTALLATION

18"X18"X12 5/8"

BEOTEST LA TABLE

1 Pumper (40480)

ALL ANCHOR FITTINGS TO BE CONCRETE THRUST BLOCKED. ALL DUCTILE OR CAST IRON FITTINGS AND OR PIPE TO

ME POLYWRAPPED. FIRE HYDRANT DAGE MATERIAL TO BE WEAPPED TH

GEOTENTILE MATERIAL

Bass+HWS 34A5}

FOR 1" + SMAURE

BASS + HAYS 55 A5 FOR 1.5" +:

GROUND LINE

90 ANGLE CURBSTOF

MUELLER "CENTURIAN" OR EQUAL

NCH THICK. 4000 PSI W/ I(MIN) #3 BARS ON 8" CENTERS 2ND SAW 30" #5 DEFORMED DOWEL -BAR "18" O.C. EPOXY GROUT INTO EXISTING PAVEMENT. **EXISTING** -CONCRETE PAVEMENT EMBEDMENT W GESTEXTILE FARSE PLACED ON TOP OF THE STONE PESOL TO PLACEMENT OF THE SCIENT OF GAMMIAR MATERIAL. COMPACTION SHALL BE PER NO 95% MAXIMUM DENSITY AS DETERMINED BY ASTM D 698. TYPICAL SECTION

TRENCH WIDT POUR AGAINST UNDISTURBED EARTH CONCRETE SHALL NOT EXTEND BEYOND JOINTS **SECTION X-X** HORIZONTAL THRUST BLOCK HORIZONTAL BEND THRUST BLOCK ∇ = 90. G A B VOL. G A B VOL. FT. FT. C.Y. FT. FT. FT. C.Y. FT. FT. C.Y. FT. FT. C.Y. FT. FT. C.Y. 1.5 | 0.9 | 0.4 | 1.0 | 1.5 | 0.1 | 0.8 | 1.5 | 1.5 | 0.1 | 1.5 | 2.0 | 2.0 | 0.2 | 2.7 | 5.0 | 1.5 | 0.4

C.Y. 2.5 0.3 1.5 10,12 3.5 0.6 1.5 1.6 16,18 2.0 5.5 6.0 1.9 2.0 24 | 2.5 7.0 USE POLYETHYLENE WRAP OR EQUAL BETWEEN CONCRETE AND PLUG TO PREVENT 7.5 3.0


GENERAL NOTES FOR ALL THRUST BLOCKS

- ALL CALCULATIONS ARE BASED ON INTERNAL PRESSURE OF 200 P.S.I. (EXCEPT 30" I.D. - 150 P.S.I.)
- 2. CONCRETE FOR BLOCKING SHALL BE CLASS B, 2000 PSI CONCRETE.
- 3. DIMENSIONS MAY BE VARIED AS REQUIRED BY FIELD CONDITIONS WHERE AND AS DIRECTED BY THE C.M. THE NET VOLUME OF CONCRETE BLOCKING SHALL NOT BE LESS THAN SHOWN IN TABLES.

TEE THRUST THRUST BLOCKING

POUR AGAINST

UNDISTURBED EARTH

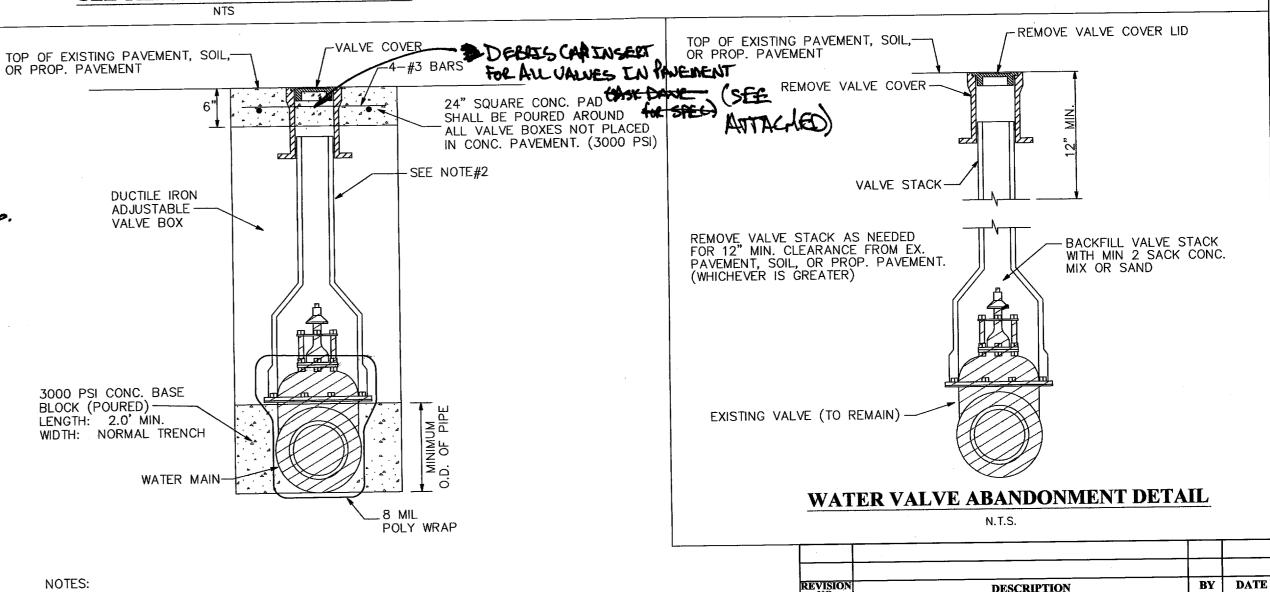

- . GATE VALVES SHALL BE IN ACCORDANCE WITH AWWA STANDARD C-509-80 OR LATEST THEREOF. ALL VALVES SHALL BE "MUELLER" OR APPROVED EQUAL.
- ANY VALVE THAT ITS OPERATING NUT IS LOCATED IN EXCESS OF 4' BELOW THE TOP OF THE VALVE BOX. THIS EXTENSION SHALL BE OF SUFFICIENT LENGTH TO INSURE THAT IT'S TOP IS WITHIN A OF VALVE BOX LID. MANUFACTURED VALVE STACK DUCTILE IRON PIPE TO BE USED FOR EXTENSION GREATER THAN . BELL END OF STACK TO BE FITTED OVER VALVE. VALVE AND VALVE STACK & TO BE POLY WRAPPED.
- 3. VALVES SHALL BE OF DUCTILE IRON W/RUBBER ENCAPSULATED DISK. BOLTS SHALL BE STAINLESS STEEL OF SAME SIZE ON EACH VALVE.

PRELIMINARY NOT FOR CONSTRUCTION BIDDING, OR PERMIT PURPOSES. FOR REVIEW ONLY. <u>QUINN G. SPANN, JR P.E. No. 6810</u> Date : <u>05/16/2008</u>

DESCRIPTION TOWN OF ADDISON, TEXAS PUBLIC WORKS DEPT. - ENGINEERING DIVISION GREENHAVEN WATERLINE RECONSTRUCTION GENERAL NOTES & MISCELLANEOUS DETAILS DALLAS, TX - FORT WORTH, TX - MIDLAND, TX - AUSTIN, TX (972) 620-1255 (817) 306-1444 (915) 689-8909 (512) 762-0542 Dallas - Fort Worth - Midland - Austin

UNDISTURBED EARTH

PLAN OF PLUG THRUST BLOCK

DESIGN: GSWW DRAWN: GSWW APPROVED: QGS

DATE: MAY, 2008

SCALE: NOTED SHEET 2 of 5

- 2. A PERMANENTLY ATTACHED VALVE EXTENSION STEM SHALL BE REQUIRED FOR
- 4. VALVE COVERS SHALL BE MARKED "WATER"

TYPICAL VALVE SETTING & BOX

N.T.S.