


Bact samples taken

B

Tom Thumb

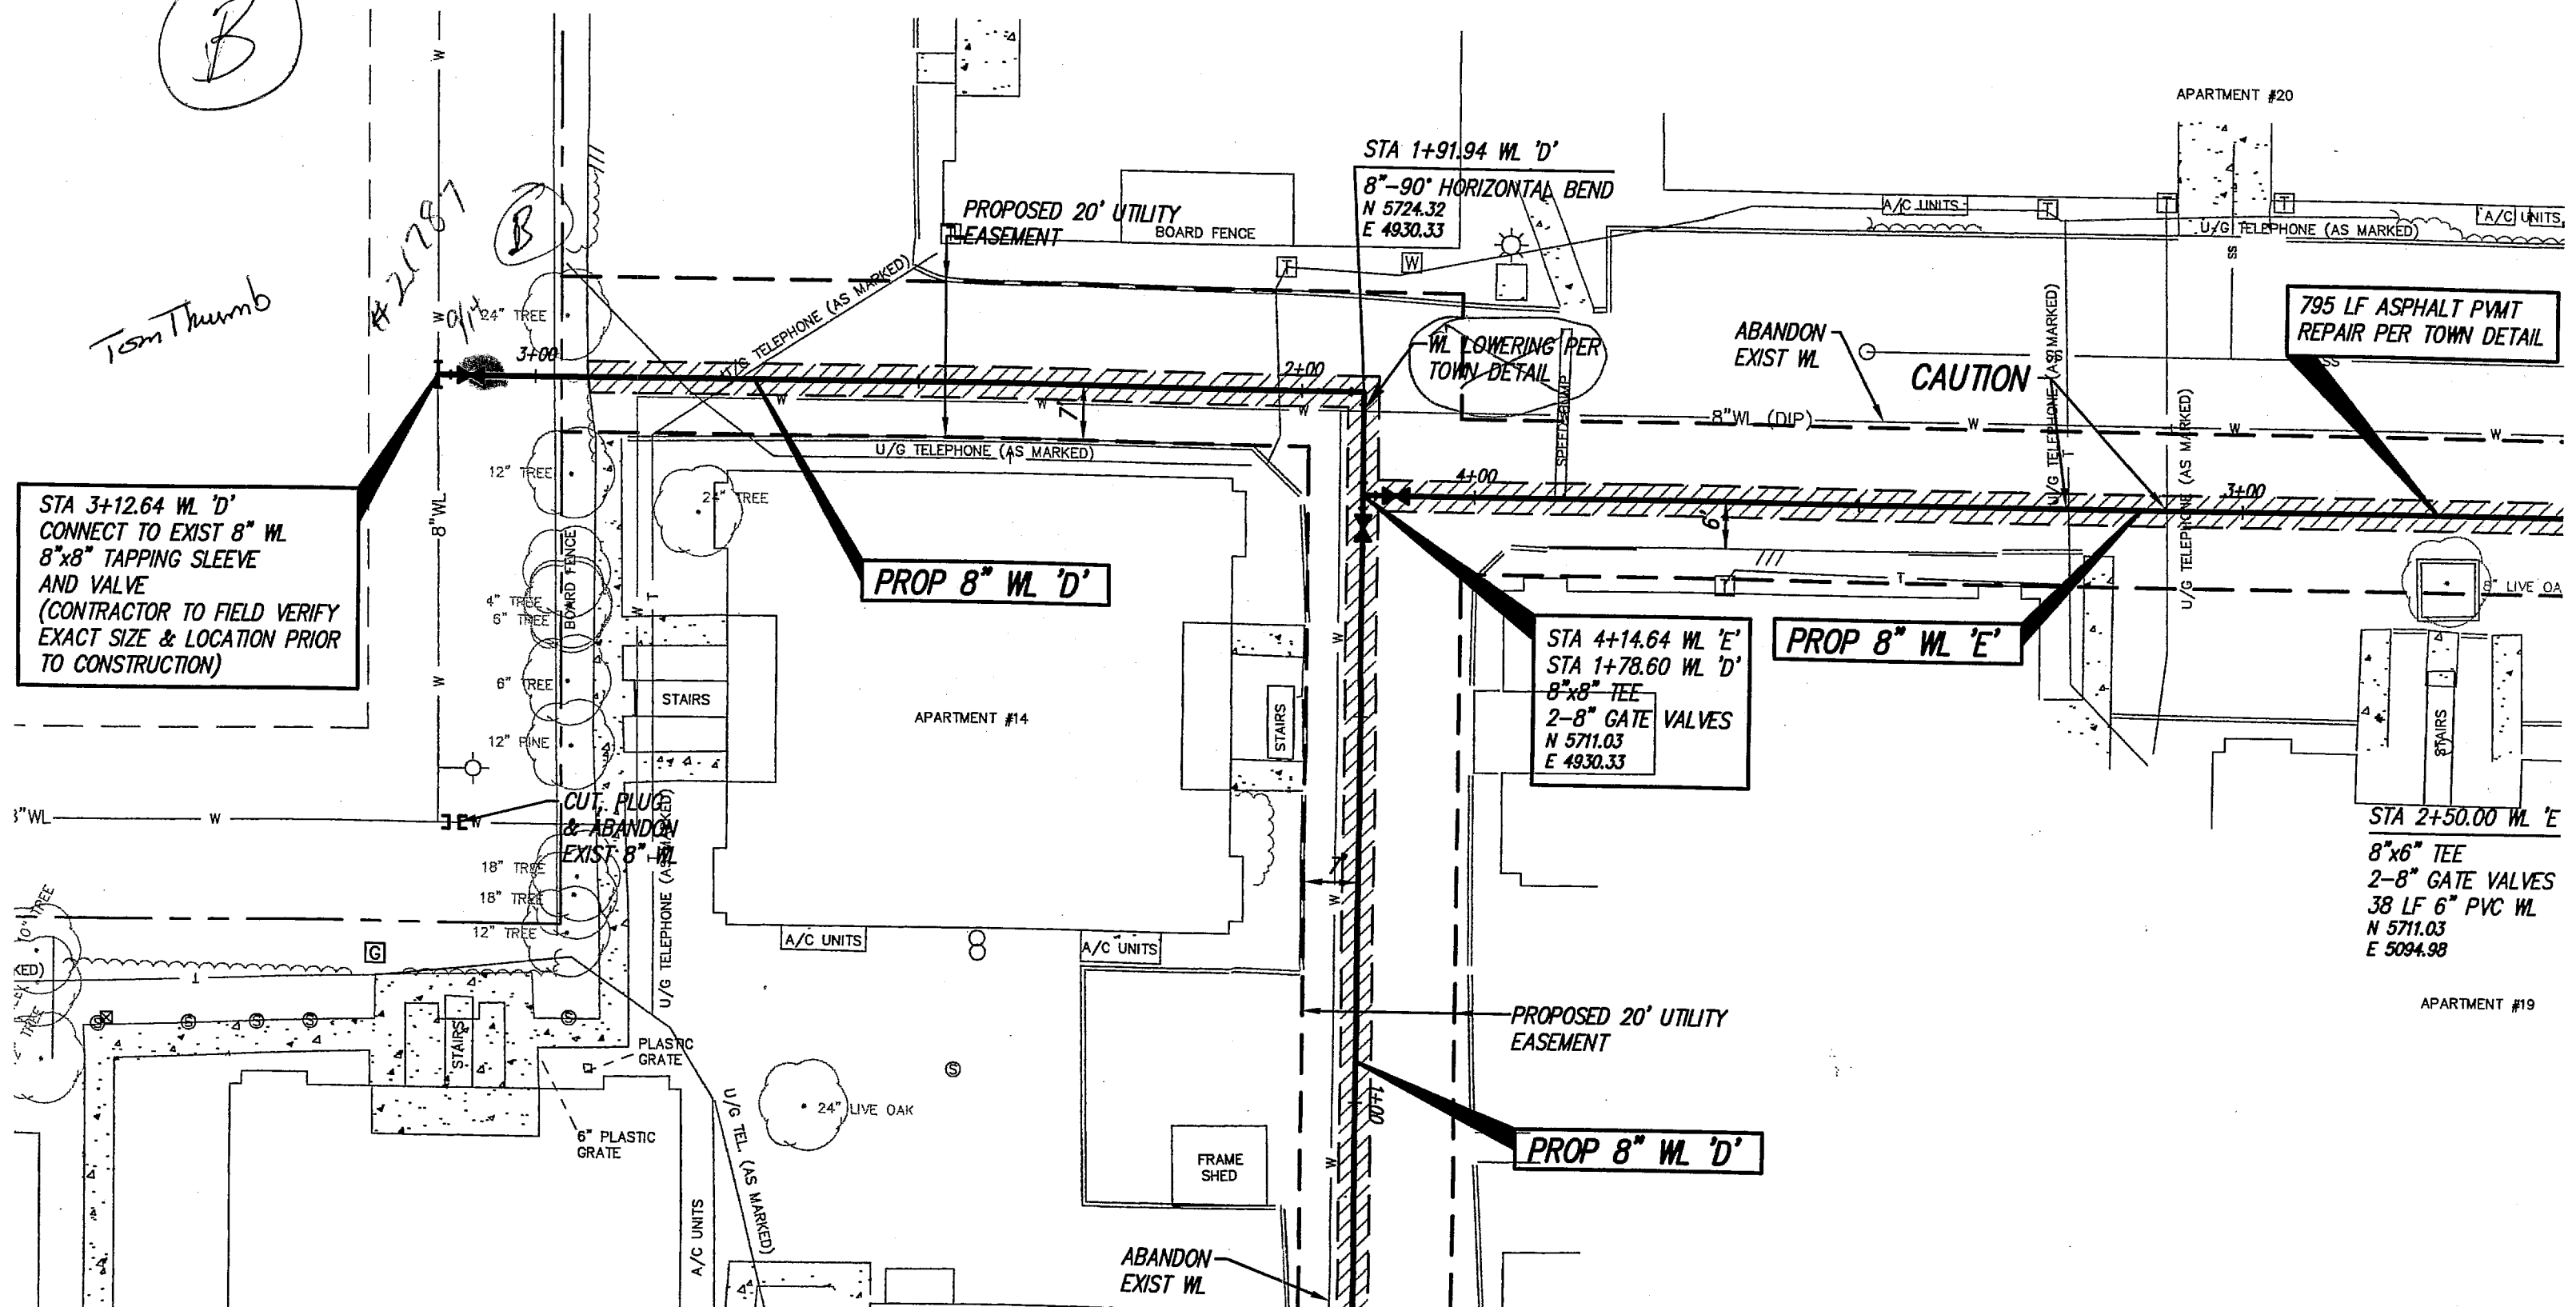

STA 3+12.64 WL 'D'  
 CONNECT TO EXIST 8" WL  
 8"x8" TAPPING SLEEVE  
 AND VALVE  
 (CONTRACTOR TO FIELD VERIFY  
 EXACT SIZE & LOCATION PRIOR  
 TO CONSTRUCTION)

PROP 8" WL 'D'

STA 1+91.94 WL 'D'  
 8"-90° HORIZONTAL BEND  
 N 5724.32  
 E 4930.33

WL LOWERING PER  
 TOWN DETAIL

STA 4+14.64 WL 'E'  
 STA 1+78.60 WL 'D'  
 8"x8" TEE  
 2-8" GATE VALVES  
 N 5711.03  
 E 4930.33

PROP 8" WL 'E'

795 LF ASPHALT PVMT  
 REPAIR PER TOWN DETAIL

STA 2+50.00 WL 'E'  
 8"x6" TEE  
 2-8" GATE VALVES  
 38 LF 6" PVC WL  
 N 5711.03  
 E 5094.98

PROP 8" WL 'D'

APARTMENT #19

APARTMENT #20

APARTMENT #14

PROPOSED 20' UTILITY  
 EASEMENT

PROPOSED 20' UTILITY  
 EASEMENT

ABANDON  
 EXIST WL

ABANDON  
 EXIST WL

CAUTION

CUT, PLUG  
 & ABANDON  
 EXIST 8" WL

6" PLASTIC  
 GRATE

FRAME  
 SHED

U/G TEL. (AS MARKED)

U/G TELEPHONE (AS MARKED)

24" LIVE OAK

18" TREE

18" TREE

12" TREE

6" TREE

6" TREE

4" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE

12" TREE